

Compliance Document for New Zealand Building Code Clause E1 Surface Water

Prepared by the Department of Building and Housing

This Compliance Document is prepared by the Department of Building and Housing. The Department of Building and Housing is a Government Department established under the State Sector Act 1988.

Enquiries about the content of this document should be directed to:



Department of
Building and Housing

Te Tari Kaupapa Whare

Department of Building and Housing
PO Box 10-729, Wellington.
Telephone 0800 242 243
Fax 04 494 0290
Email: info@dbh.govt.nz



Sales enquiries should be directed to:
Customer Services,
Victoria University Book Centre
PO Box 12-337, Wellington, New Zealand
Telephone 0800 370 370, (04) 463 5511
Fax (04) 463 5510
Email: dbh@vicbooks.co.nz
www.vicbooks.co.nz
ISBN 0-477-01606-5

© Department of Building and Housing 2006

This Compliance Document is protected by Crown copyright, unless indicated otherwise. The Department of Building and Housing administers the copyright in this document. You may use and reproduce this document for your personal use or for the purposes of your business provided you reproduce the document accurately and not in an inappropriate or misleading context. You may not distribute this document to others or reproduce it for sale or profit.

The Department of Building and Housing owns or has licences to use all images and trademarks in this document. You must not use or reproduce images and trademarks featured in this document for any purpose (except as part of an accurate reproduction of this document) unless you first obtain the written permission of the Department of Building and Housing.

Status of Compliance Documents

Compliance Documents are prepared by the Department of Building and Housing in accordance with section 22 of the Building Act 2004. A Compliance Document is for use in establishing compliance with the New Zealand Building Code.

A person who complies with a Compliance Document will be treated as having complied with the provisions of the Building Code to which the Compliance Document relates. However, a Compliance Document is only one method of complying with the Building Code. There may be alternative ways to comply.

Users should make themselves familiar with the preface to the New Zealand Building Code Handbook, which describes the status of Compliance Documents and explains alternative methods of achieving compliance.

Defined words (italicised in the text) and classified uses are explained in Clauses A1 of the Building Code and in the Definitions at the start of this Compliance Document.

E1: Document History			
	Date	Alterations	
First published	July 1992		
Amendment 1	September 1993	pp. vi and vii, References p. 14, 3.2.1, Figure 3 p. 16, Table 2 p. 18, 3.7.4 p. 20, Figure 13	p. 21, Figure 14 p. 22, Table 4, Table 5, 5.1, 5.1.1, 5.1.2 p. 23, Figure 15, Figure 16 p. 24, 5.1.3, 5.1.4
Amendment 2	19 August 1994	pp. i and ii, Document History p. vi, NZS 3441 replaced NZS 3403	p. 21, 3.9.8 p. 22, Table 4, Table 5 p. 24, 5.1.3, Table 6
Reprinted incorporating Amendments 1 and 2	October 1994		
Amendment 3	1 December 1995	p. ii, Document History	p. iii, E1.3.1
Reprinted incorporating Amendments 1, 2 and 3	July 1996		
Amendment 4	1 December 2000	p. ii, Document History p. v, Contents pp. vi and vii, References	p. viii, Definitions pp. 1 – 12K, Revised VM1 pp. 27 and 28, Index
Amendment 5		p. 2, Document History, Status p. 7, References p. 31, 9.0.5	p. 39, 3.8.1 p. 42, 4.3.2
Amendment 6	6 January 2002	p. 3 Code Clause E1	
Reprinted incorporating Amendments 4, 5 and 6	September 2003		
Note: Page numbers relate to the document at the time of Amendment and may not match page numbers in current document.			

Document Status

The most recent version of this document, as detailed in the Document History, is approved by the Chief Executive of the Department of Building and Housing. It is effective from 6 January 2002 and supersedes all previous versions of this document.

People using this Compliance Document should check for amendments on a regular basis. The Department of Building and Housing may amend any part of any Compliance Document at any time. Up-to-date versions of Compliance Documents are available from www.dbh.govt.nz

New Zealand Building Code

Clause E1 Surface Water

Amend 6
Jan 2002

The mandatory provisions for building work are contained in the New Zealand Building Code (NZBC), which comprises the First Schedule to the Building Regulations 1992. The relevant NZBC Clause for Surface Water is E1.

FIRST SCHEDULE—continued

Clause E1—SURFACE WATER

Provisions

Limits on application

OBJECTIVE

E1.1 The objective of this provision is to:

- (a) Safeguard people from injury or illness, and *other property* from damage, caused by *surface water*, and
- (b) Protect the *outfalls* of drainage systems.

FUNCTIONAL REQUIREMENT

E1.2 *Buildings* and *sitework* shall be constructed in a way that protects people and *other property* from the adverse effects of *surface water*.

PERFORMANCE

E1.3.1 Except as otherwise required under the Resource Management Act 1991 for the protection of *other property*, *surface water*, resulting from an event having a 10% probability of occurring annually and which is collected or concentrated by *buildings* or *sitework*, shall be disposed of in a way that avoids the likelihood of damage or nuisance to *other property*.

E1.3.2 *Surface water*, resulting from an event having a 2% probability of occurring annually, shall not enter *buildings*.

E1.3.3 Drainage systems for the disposal of *surface water* shall be constructed to:

- (a) Convey *surface water* to an appropriate *outfall* using gravity flow where possible,
- (b) Avoid the likelihood of blockages,
- (c) Avoid the likelihood of leakage, penetration by roots, or the entry of ground water where pipes or lined channels are used,

Performance E1.3.2 shall apply only to *Housing, Communal Residential* and *Communal Non-residential buildings*.

Amend 6
Jan 2002

Amend 6
Jan 2002

1992/150

Building Regulations 1992

37

FIRST SCHEDULE—continued**Provisions****Limits on application**

- (d) Provide reasonable access for maintenance and clearing blockages,
- (e) Avoid the likelihood of damage to any *outfall*, in a manner acceptable to the *network utility operator*, and
- (f) Avoid the likelihood of damage from superimposed loads or normal ground movements.

Contents

	Page		Page
References	7	Acceptable Solution E1/AS1	33
Definitions	9	1.0 Limitations of the Solution	33
Verification Method E1/VM1	11	2.0 Minimum Acceptable Floor Level	33
1.0 Scope	11	3.0 Drainage System Materials and Construction	34
2.0 Estimation of Surface Water Run-off	11	3.1 Materials	34
2.1 Run-off coefficient	12	3.2 Sizing of drains	34
2.2 Rainfall intensity	12	3.3 Alignment and gradient of drains	34
2.3 Time of concentration	13	3.4 Minimum gradients	34
3.0 Sizing of Surface Water System	16	3.5 Jointing of drains	36
3.1 Minimum size of drains	16	3.6 Surface water inlets to drains	36
3.2 Hydraulic design	16	3.7 Access for maintenance	37
3.3 Pipe materials	17	3.8 Testing of drains	39
4.0 Secondary Flow	17	3.9 Bedding and backfilling	39
4.1 Secondary flow from a piped surface water drainage system upstream of the site	18	4.0 Downpipes	42
4.2 Secondary flow from an open water course upstream of the site	24	4.1 Materials	42
4.3 Secondary flow from site to downstream drainage system	27	4.2 Sizing of downpipes	42
5.0 Energy Losses Through Structures	27	4.3 Installation of downpipes	42
6.0 Minimum Velocity	27	5.0 Roof Gutters	42
7.0 Outfall Protection	29	5.1 Size of roof gutter	42
8.0 Drain Leakage Tests	29	5.2 Materials	44
8.1 Water test	29	5.3 Gradients	44
8.2 Low pressure air test	29	5.4 Thermal movement	44
8.3 High pressure air test	30	5.5 Overflow outlets	44
9.0 Disposal to soak pit	30	Appendix A	
		Rainfall intensities	45
		Index	47

Amend 4
Dec 2000

Amend 4
Dec 2000

References

Amend 1
Sep 1993

For the purposes of New Zealand Building Code compliance, acceptable reference documents include only the quoted edition and specific amendments as listed below.

Standards New Zealand

Amend 1
Sep 1993

NZS/BS 970:- Specification for wrought steels for mechanical and allied engineering purposes
Part 1: 1991 General inspection and testing procedures and specific requirements for carbon, carbon manganese, alloy and stainless steels

Where quoted

AS1 Table 4,
Table 6

Amend 2
Aug 1994

NZS/BS 1560:- Circular flanges for pipes, valves and fittings (class designated)
Part 3:- Steel, cast iron and copper alloy flanges
Section 3.1: 1989 Specification for steel flanges

AS1 Table 3

NZS/AS 2033: 1980 Installation of polyethylene pipe systems

AS1 Table 3

NZS/BS 2494: 1990 Specification for elastomeric seals for joints in pipework and pipelines

AS1 Table 3

NZS 3107: 1978 Specification for precast concrete drainage and pressure pipes

AS1 Table 1

NZS 3124: 1987 Specification for concrete construction for minor works

AS1 Table 6

NZS 3302: 1983 Specification for ceramic pipes, fittings and joints

AS1 Table 1,
Table 3

Amend 5
July 2001

NZS 3441: 1978 Specification for hot-dipped zinc-coated steel coil and cut lengths
Amend: 1, 2

AS1 Table 4,
Table 6

NZS 3604: 1999 Timber framed buildings
Amend: 1

AS1 3.9.7

Amends
1 and 4

NZS 4229: 1999 Concrete masonry buildings not requiring specific design
Amend: 1

AS1 3.9.7

Amend 1
Sep 1993

NZS 4442: 1988 Welded steel pipes and fittings for water, sewage and medium pressure gas

AS1 Table 1,
Table 3

NZS 4452: 1986 Code of practice for the construction of underground pipe sewers and drains
Amend: 1

AS1 3.9.8

NZS 7604: 1981 Specification for high density polyethylene drain and sewer pipe and fittings

AS1 Table 1

Amend 1
Sep 1993

NZS 7609:- Acrylonitrile butadiene styrene (ABS) pipes and fittings for pressure applications
Part 1: 1990 Pipes
Amend: A
Part 2: 1990 Solvent cement fittings
Amend: A

AS1 Table 1,
Table 3

AS1 Table 1,
Table 3

		Where quoted	
	NZS 7642: 1971	Specification for unplasticised PVC soil and ventilating pipe, fittings and accessories <i>Amend: A, 1, 1A, 2, 2A</i>	AS1 Table 4
Amend 1 Sep 1993	NZS 7643: 1979	Code of practice for the installation of unplasticised PVC pipe systems <i>Amend: 1</i>	AS1 Table 3, 3.9.8
	NZS 7649: 1988	Unplasticized PVC sewer and drain pipe and fittings	AS1 Table 1
British Standards Institution			
Amend 1 Sep 1993	BS 1470: 1987	Specification for wrought aluminium and aluminium alloys for general engineering purposes: plate, sheet and strip <i>Amend: 6032</i>	AS1 Table 4, Table 6
	BS 2870: 1980	Specification for rolled copper and copper alloys: sheet, strip and foil	AS1 Table 4, Table 6
	BS 6561: 1985	Specification for zinc alloy sheet and strip for building	AS1 Table 4, Table 6
Standards Association of Australia			
	AS 1254: 1991	Unplasticised PVC (UPVC) pipes and fittings for storm and surface water applications	AS1 Table 1, Table 3
	AS 1273: 1991	Unplasticised PVC (UPVC) downpipes and fittings for rainwater	AS1 Table 4, Table 6
	AS 1741: 1991	Vitrified clay pipes and fittings with flexible joints – sewerage quality	AS1 Table 1
Amend 1 Sep 1993	AS 2280: 1991	Ductile iron pressure pipes and fittings	AS1 Table 1, Table 3
Amend 4 Dec 2000	AS 3706:- Part 1: 1990	Geotextiles – Methods of test General requirements, sampling, conditioning, basic physical properties and statistical analysis	VM19.0.4
New Zealand Legislation			
	Resource Management Act 1991		VM12.1.2

Definitions

This is an abbreviated list of definitions for words or terms particularly relevant to this Approved Document. The definitions for any other italicised words may be found in the New Zealand Building Code Handbook.

Access chamber A chamber with working space at *drain* level through which the *drain* passes either as an open channel or as a pipe incorporating an inspection point.

Building has the meaning ascribed to it by the Building Act 1991.

Construct in relation to a *building*, includes to build, erect, prefabricate, and relocate; and **construction** has a corresponding meaning.

Drain A pipe normally laid below ground level including fittings and equipment and intended to convey *foul water* or *surface water* to an *outfall*.

Inspection chamber A chamber with working space at ground level through which the *drain* passes either as an open channel or as a pipe incorporating an *inspection point*.

Inspection point A removable cap at *drain* level through which access may be made for cleaning and inspecting the drainage system.

Network utility operator means a *person* who:

- a) Undertakes the distribution or transmission by pipeline of natural or manufactured gas, petroleum, or geothermal energy; or
- b) Is an electricity operator or electrical distributor as defined by section 2(1) of the Electricity Act 1992 for the purposes of any works defined by that Act; or
- c) Undertakes the piped distribution of *potable* water for supply; or
- d) Is the operator of a sewerage system or a stormwater drainage system.

Other property means any land or *buildings* or part thereof which are:

- a) Not held under the same *allotment*; or
- b) Not held under the same ownership – and includes any road.

Outfall That part of the disposal system receiving *surface water* or *foul water* from the drainage system. For *foul water*, the

outfall may include a *foul water sewer* or a septic tank. For *surface water*, the *outfall* may include a natural water course, kerb and channel, or a soakage system.

Rodding point A removable cap at ground level through which access may be made for cleaning and inspecting the drainage system.

Secondary flow path The path over which *surface water* will follow if the drainage system becomes overloaded or inoperative.

Sewer A *drain* that is under the control of, or maintained by, a *network utility operator*.

Sitework means work on a *building* site, including earthworks, preparatory to or associated with the *construction*, *alteration*, demolition or removal of a *building*.

Sump A chamber which is installed in the *drain* and incorporates features to intercept and retain silt, gravel and other debris.

Surface water All naturally occurring water, other than sub-surface water, which results from rainfall on the site or water flowing onto the site, including that flowing from a *drain*, stream, river, lake or sea.

Territorial authority has the meaning ascribed to it by section 2 of the Local Government Act 1974; and includes any organisation which is authorised to permit structures pursuant to section 12(1)(b) of the Resource Management Act 1991.

Trap A chamber which is installed in the *drain* and incorporates features to intercept and retain floatable debris.

Amend 4
Dec 2000

Verification Method E1/VM1

(Revised by Amendment 4)

1.0 Scope

1.0.1 This Verification Method shall be used only if the *territorial authority* does not have more accurate data available from sophisticated hydrological modelling of the catchment undertaken as part of its flood management plans.

1.0.2 The following approach provides a method for verifying that a proposed *building* will meet the requirements of NZBC E1.3.1 and E1.3.2 in the following circumstances:

- a) The catchment area does not exceed 100 ha (but see Paragraph 1.0.6 for soak pits), and
- b) The *surface water* results only from rainfall on the catchment and does not include water from other sources such as inundation from rivers, lakes or the sea.

1.0.3 The method describes how to determine:

- a) The volume of *surface water* arriving at the *building* site from upper areas of the catchment (see Paragraph 2.0),
- b) The size of *drains* necessary to remove *surface water* from the *building* site (see Paragraph 3.0), and
- c) The nature and volume of secondary flows likely to reach the *building* 1 from overloaded culverts, *drains* or open channels in the upper catchment (see Paragraph 4.0).

1.0.4 The procedure described for sizing *drains* only applies where free flow occurs at the outlet. The outlet must not be restricted by hydraulic impediments such as control gates, a pump station, or submerged outlets in a river, a lake or the sea.

COMMENT:

The capacity of *drains* which do not have a free flowing outlet shall be calculated by specific design in a manner which incorporates the effect of the restriction.

1.0.5 A method is provided for determining appropriate *outfall* protection.

1.0.6 A procedure is provided for determining soak pit requirements for *surface water* disposal. Such disposal is subject to suitable ground conditions, as confirmed by site tests.

COMMENT:

1. Where soak pits are used the overall ground stability may need to be verified but this is outside of the scope of this Verification Method.
2. Soak pit *surface water* disposal may require a resource management consent.

1.0.7 The design procedures in this document must be performed by a *person* who, on the basis of experience or qualifications, is competent to apply them.

1.0.8 This document makes no allowance for blockages to the intakes of *drains* or culverts. The procedures of this document shall only be used where the designer demonstrates that this approach is justified for the particular *building* work under consideration.

COMMENT:

The likelihood of blockage and the resulting risks will vary from project to project and need to be considered by the designer before applying this document.

1.0.9 The "Comments" in this document provide comment, background or general information but do not form part of this Verification Method.

2.0 Estimation of Surface Water Run-Off

2.0.1 *Surface water* run-off for the catchment shall be calculated using the Rational Method. The formula to be used is:

$$Q_c = CIA_c/360$$

where

$$Q_c = \text{catchment run-off (m}^3\text{/s).}$$

$$C = \text{run-off coefficient (see Table 1).}$$

$$I = \text{rainfall intensity (mm/hr).}$$

$$A_c = \text{area (hectares) of catchment above the point being considered.}$$

Table 1: Run-off Coefficients
Paragraphs 2.0.1, 2.1.1, 2.1.3

Description of surface	C
Natural surface types	
Bare impermeable clay with no interception channels or run-off control	0.70
Bare uncultivated soil of medium soakage	0.60
Heavy clay soil types:	
– pasture and grass cover	0.40
– bush and scrub cover	0.35
– cultivated	0.30
Medium soakage soil types:	
– pasture and scrub cover	0.30
– bush and scrub cover	0.25
– cultivated	0.20
High soakage gravel, sandy and volcanic soil types:	
– pasture and scrub cover	0.20
– bush and scrub cover	0.15
– cultivated	0.10
Parks, playgrounds and reserves:	
– mainly grassed	0.30
– predominantly bush	0.25
Gardens, lawns, etc.	0.25
Developed surface types	
Fully roofed and/or sealed developments	0.90
Steel and non-absorbent roof surfaces	0.90
Asphalt and concrete paved surfaces	0.85
Near flat and slightly absorbent roof surfaces	0.80
Stone, brick and precast concrete paving panels	
– with sealed joints	0.80
– with open joints	0.60
Unsealed roads	0.50
Railway and unsealed yards and similar surfaces	0.35
Land use types	
Industrial, commercial, shopping areas and town house developments	0.65
Residential areas in which the impervious area is less than 36% of gross area	0.45
Residential areas in which impervious area is 36% to 50% of gross area	0.55
Note: Where the impervious area exceeds 50% of gross area, use method of Paragraph 2.1.2.	

2.1 Run-off Coefficient

2.1.1 Table 1 lists run-off coefficients appropriate to a variety of land uses and soil

characteristics. For catchments having a mixture of different types, the run-off coefficient shall be determined by averaging the value for individual parts of the catchment by using the formula:

$$C = \frac{C_i A_i}{A_c}$$

where

C = the run-off coefficient for the catchment.

C_i = the run-off coefficient for a particular land use.

A_i = the area of land to which C_i applies.

A_c = the catchment area.

COMMENT:

1. The run-off coefficient C is the variable in the rational formula least able to be precisely determined, and represents the integrated effects of such things as infiltration, storage, evaporation, natural retention and interception, all of which affect the time distribution and peak rate of run-off.

2. The run-off coefficients given in Table 1 assume saturated ground conditions from previous rain, and shall be used in the calculation of *surface water* run-off.

2.1.2 The chosen run-off coefficient shall be based on the conditions likely to exist after the full catchment development allowable by the operative plan under the Resource Management Act 1991.

2.1.3 Slope correction

The values of run-off coefficient given in Table 1 shall be adjusted for slope in accordance with Table 2.

COMMENT:

The values in Table 1 assume an average sloping terrain of 5-10% (i.e. gently rolling). However, if the terrain is flatter or steeper this will have the effect of slowing down or speeding up overland flow. The above adjustment allows for this.

2.2 Rainfall intensity

2.2.1 The rainfall intensity shall be that for a storm having a duration equal to the time of concentration as determined by Paragraph 2.3.1, and a probability of occurrence as given by NZBC E1.3.1 or E1.3.2 as appropriate. Either local rainfall intensity curves produced by the *territorial authority* or rainfall frequency

duration information produced by NIWA shall be used to determine the rainfall intensity.

COMMENT:

Rainfall intensity curves are available for most areas. These have been developed from meteorological data. Rainfall frequency-duration tables for each official rain gauge throughout New Zealand are also available. Rainfall frequency duration data is also available from NIWA, in digital form, as HIRDS (High Intensity Rainfall Design System).

COMMENT:

In some catchments due to shape, *surface water* network and varying permeabilities within the catchment, part of the catchment under consideration may produce a higher peak flow than the whole of the catchment. Although the area for the part catchment is smaller, this may be more than offset by the higher intensity storm associated with a shorter time of concentration and storm duration. This situation will generally arise where the lower reaches of a catchment are densely developed.

Table 2: Slope Correction for Run-off Coefficients Paragraph 2.1.3		
Ground slope Adjust C by:		
0-5%	subtracting	0.05
5-10%	no adjustment	
10-20%	adding	0.05
20% or steeper	adding	0.10

2.3 Time of concentration

2.3.1 The time of concentration used to determine rainfall intensity is the time taken for *surface water* run-off from the furthest point (in time) of the catchment to reach the design point. Flow time calculations shall take account of catchment run-off coefficients and slopes.

Time of concentration for the catchment t_c (minutes) shall be calculated from the formula:

$$t_c = t_e + t_f$$

but shall be no less than 10 minutes.

Where

t_e = time of entry (minutes) which is the run-off time for overland travel (i.e. via ground, roofs, downpipes, carriageways or road channels) to the point of entry to a *drain* or open channel.

t_f = time (minutes) of network flow, (comprising flow in pipes and open channels), to the design point.

2.3.2 Time of entry t_e

The time of entry t_e :

a) Where the catchment area has a well defined and regularly repeated pattern for directing the *surface water* to the *drain* or open channel, the time of entry may be taken as:

t_e = 5 minutes for commercial or industrial areas where greater than 50% of the surface of the catchment area feeding the *drain* or open channel consists of roofed, asphalt, concrete, paved or metalled surfaces.

t_e = 7 minutes for residential areas where the impervious area exceeds 50% of gross area.

t_e = 10 minutes for low density residential areas where the impervious area is 36% to 50% of gross area.

b) Where the catchment does not have a well defined and regularly repeated pattern or where the catchment is longer than 1.0 km, the time of entry t_e shall be the sum of the time of overland flow and, if applicable, the time of road channel flow as given in i) and ii) below:

i) the time of overland flow shall be determined by the formula:

$$t = 100 nL^{0.33}/s^{0.2}$$

where

t = time (minutes).

L = length of overland flow (m).

s = slope (%).

n = Manning's 'n' (roughness coefficient).

The results from this formula, for normal surface types, are shown in Figure 1.

- ii) The time of road channel flow, which is the time taken for water to flow from the point of entering the road channel, to the point of discharge to a sump, catchpit, drain or other outlet, shall be determined from Figure 2.

2.3.3 Time of network flow

The time of network flow t_f shall be determined from the sum of the travel times within pipes and open channels.

2.3.4 Time of pipe flow

The time of pipe flow shall be calculated from the velocity as determined from Figure 3. Where the pipe changes in material, diameter or gradient the time taken in each section of the pipe shall be calculated and the component times summed. For pipes with Manning's 'n' other than 0.013 the velocity determined from Figure 3 shall be multiplied by the ratio of 0.013/n. Other values of Manning's 'n' for different pipe materials are given in Table 3.



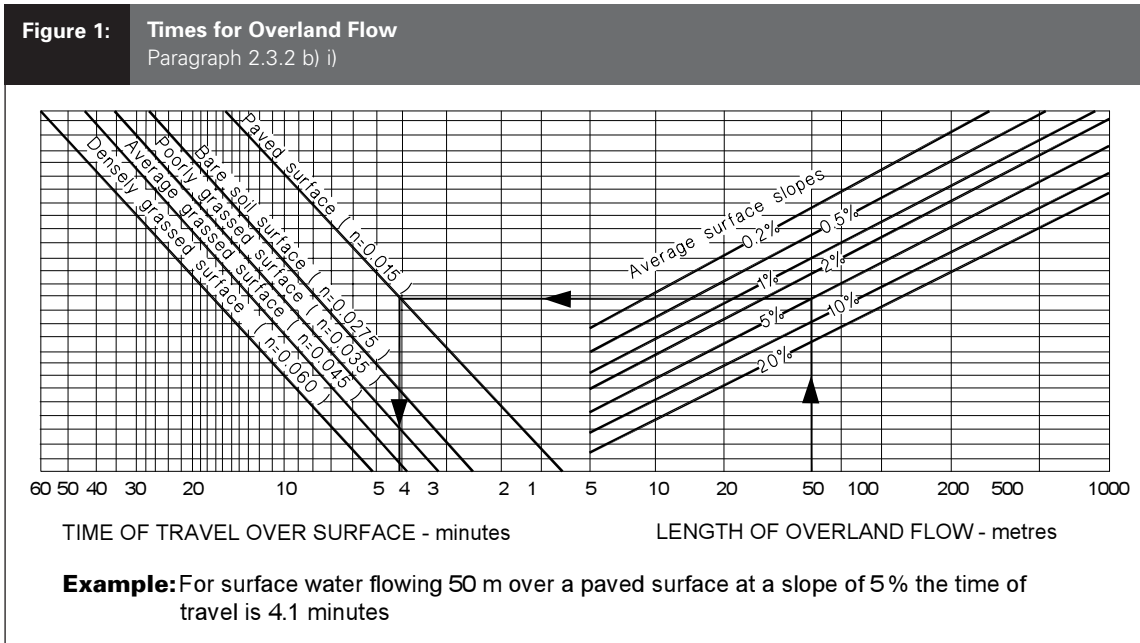


Figure 3: Pipe Flow Relationships for Different Combinations of Internal Diameter, Velocity and Gradient
 (Based on Manning's formula using $n = 0.013$ with an allowance for air entrainment)
 Paragraphs 2.3.4 and 3.2.1

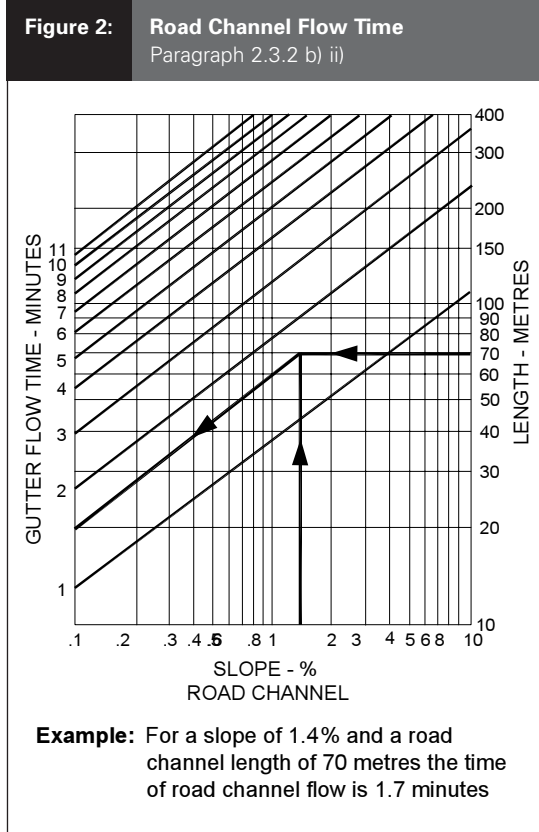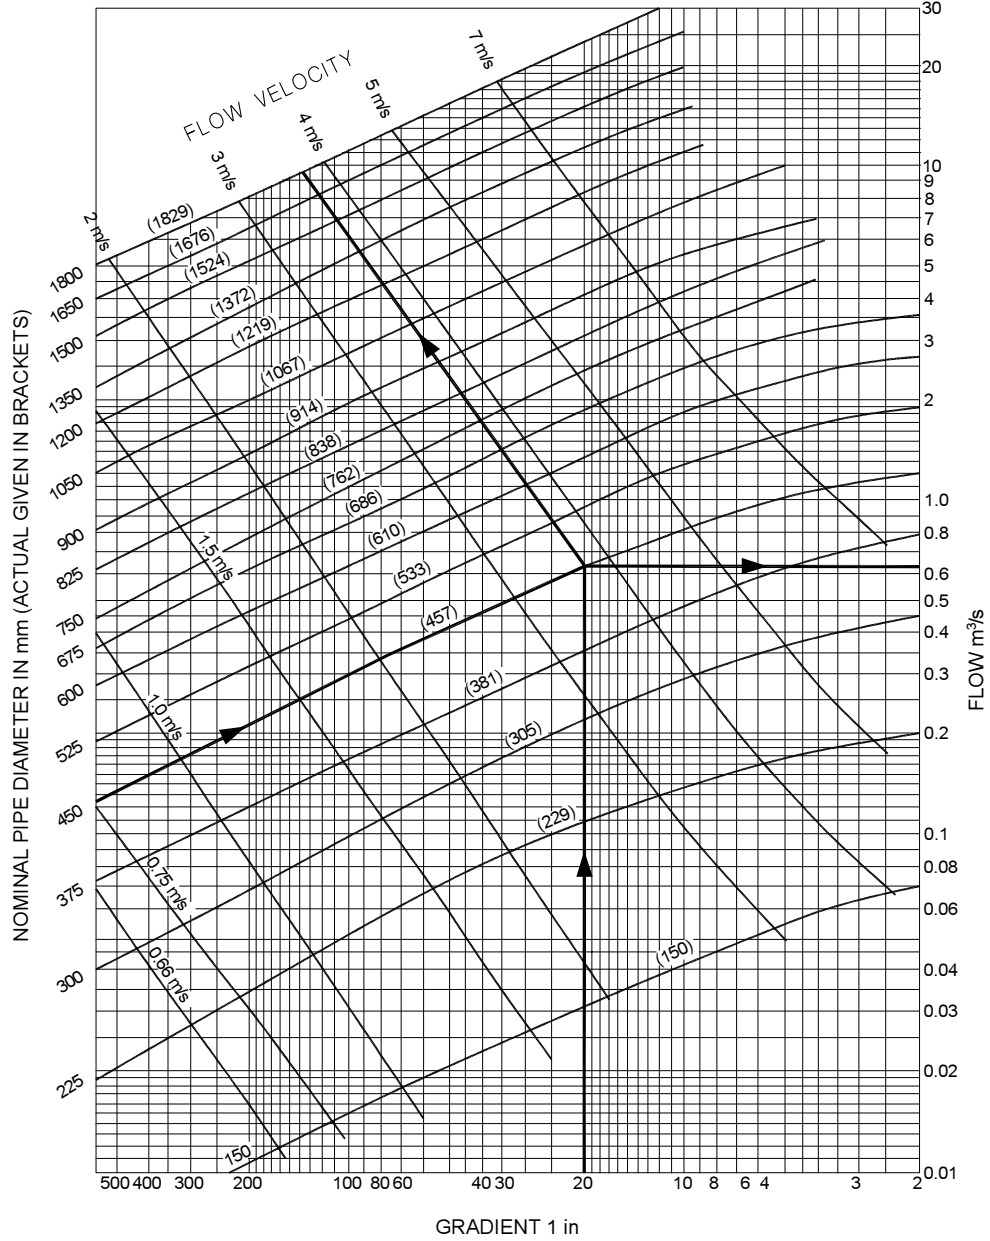

Example: A 450 internal diameter pipe with a gradient of 1 in 20 will have a flow of $0.63 m^3/s$ at a velocity of $3.75 m/s$

Table 3: Mannings 'n'
Paragraphs 2.3.4, 3.2.1, 4.1.6, 4.1.8, 4.1.11 and 4.2.1

Description	Value of 'n'
Circular pipes	
HDPE and uPVC	0.011
Ceramic and concrete	0.013
Culverts	
Cast-in-situ concrete	0.015
Corrugated metal	0.025
Open stream	
Straight uniform channel in earth and gravel in good condition	0.0225
Unlined channel in earth and gravel with some bends and in fair condition	0.025
Channel with rough stoney bed or with weeds on earth bank and natural streams with clean straight banks	0.03
Winding natural streams with generally clean bed but with some pools and shoals	0.035
Winding natural stream with irregular cross-section and some obstruction with vegetation and debris	0.045
Irregular natural stream with obstruction from vegetation and debris	0.06
Very weedy irregular winding stream obstructed with significant overgrown vegetation and debris	0.1

2.3.5 Time of open channel flow

The time of flow in open channels (either watercourses or lined channels), shall be calculated by means of Manning's formula as given by Paragraph 3.0.

2.3.6 Alternative method to determine time of concentration

Where there are significant changes in gradient along the channel slope or where the open channel is in a rural area, the time of concentration t_c may be determined from:

$$t_c = 0.0195 (L^3 / H)^{0.385}$$

where

- t_c = time of concentration (minutes).
- L = length of catchment (m) measured along the flow path.
- H = rise from bottom to top of catchment (m).

2.3.7 If the actual catchment slope varies significantly from the value H/L (e.g. with a sudden steepening in the upper reaches) the average slope and height h shall be determined from the equal areas method shown in Figure 4. Height h shall be substituted for H in the formula.

3.0 Sizing of Surface Water System

3.1 Minimum size of drains

3.1.1 To avoid blockages, *surface water drains* shall have an internal diameter of no less than 85 mm.

3.1.2 Except as allowed by Paragraph 5.0.2, the internal diameter of a *drain* shall not decrease in size in the direction of flow.

3.2 Hydraulic design

3.2.1 The cross-sectional area of the *drain* conveying surface water run-off Q_c to the *outfall* shall be determined by:

$$A_p = Q_c / v$$

where

A_p = cross-sectional area of *drain* (m²).

Q_c = *surface water* run-off (m³/s).

v = flow velocity (m/s).

The flow velocity v shall be determined from Manning's formula:

$$v = R^{2/3} S^{1/2} n^{-1}$$

where

R = hydraulic radius (m) = A_p / P .


P = wetted perimeter of the cross-section of the flow (m).

S = slope = vertical rise/horizontal distance.

n = Manning's 'n' (roughness coefficient). See Table 3.

Where the *drain* is to be constructed using a piped section, Figure 3 may be used to determine pipe size instead of the above calculation procedure. Where the pipe material has a Manning's 'n' of 0.013, Figure 3 can be used directly. For other values of Manning's 'n', the flow in the pipe Q_p shall be modified

Figure 4: Equal Areas Method
Paragraph 2.3.7

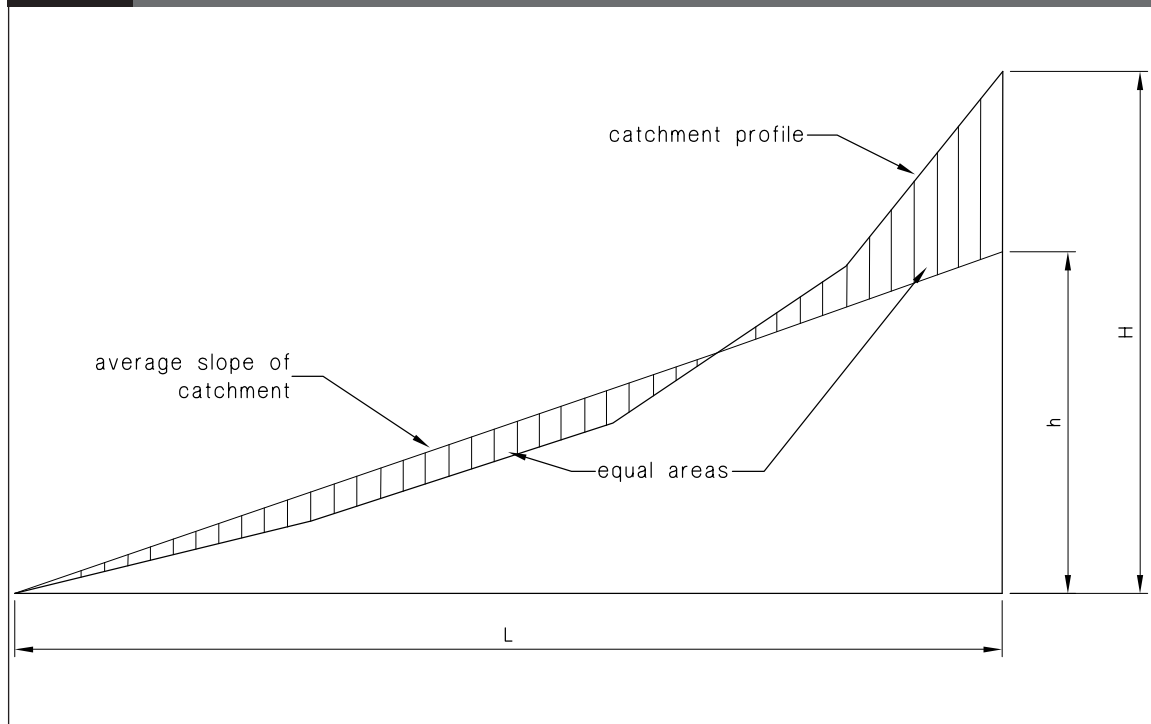

by multiplying it by the ratio of $n/0.013$ before entering the Figure.

3.2.2 The designer shall estimate the headwater depth H_w (height of water level above inlet invert, refer to Figure 5 (a)) for the size of *drain* (determined from Paragraph 3.2.1), and confirm that there is sufficient ground depth available at the inlet to the *drain* to contain H_w without causing flooding to the *building* site or secondary flow from the inlet. If there is insufficient depth to contain the headwater the *drain* size shall be increased until H_w is less than the ground depth available at the *drain* inlet.

3.2.3 The headwater depth H_w (m) for the *drain* shall be determined from:

- Figure 6 for a circular piped system, or
- Figure 7 for a box culvert system.

3.2.4 Where a *drain* gradient exceeds 1 in 10 an allowance for the bulking of the flow due to air entrainment shall be made by multiplying the area of the pipe by:

$$(1 + kv^2/gR)$$

where

- k = coefficient of entrainment
= 0.004 for smooth concrete pipes, or
= 0.008 for cast-in-situ concrete culverts.
- v = flow velocity (m/s).
- R = hydraulic radius (m).
- g = acceleration due to gravity = 9.8 m/s².

3.3 Pipe materials

Pipe materials shall comply with Table 1 of acceptable solution E1/AS1.

4.0 Secondary Flow

4.0.1 Secondary flow occurs where *surface water* arrives at the site from an overflowing drainage system upstream in the catchment. Where there is a drainage system, being a pipe, culvert or open water course, upstream of the *building* site, the potential for a

secondary flow path between the drainage system and the site shall be assessed. This shall involve determination of the capacity of the drainage system in conjunction with assessment of the ground levels in the general area.

COMMENT:

Secondary flow is not likely to cause flooding at the building site if the surface water run-off from the catchment above the site is less than 0.3 m³/s unless the site is in a depression capable of ponding water.

4.1 Secondary flow from a piped surface water drainage system upstream of the site

4.1.1 This method applies to the assessment of secondary flow upstream of inlet controlled, and some outlet controlled, pipes and culverts (see Figure 5), provided that free flow occurs at the outlet (i.e. the outlet is not restricted by hydraulic obstructions such as control gates, a pump station or submerged outlets in a river or lake).

4.1.2 The method does not apply to outlet controlled pipes or culverts where the tailwater depth T_w (m) is less than the height D (m) of the pipe or culvert (see Figure 5 (f) i.e. outlet not flowing full), and where the estimated headwater depth H_w (m) is no greater than 0.75 D . Such situations shall be subject to specific design.

4.1.3 The headwater depth H_w shall be determined for both the inlet and outlet controlled flow conditions and the maximum value shall be used to assess secondary flow.

4.1.4 Assessment of H_w for inlet controlled pipe or culverts, see Figures 5 (a) and (b)

The headwater depth H_w for a system with inlet control shall be determined from:

- Figure 6 for a circular piped system, or
- Figure 7 for a box culvert system.

4.1.5 Assessment of H_w for outlet controlled pipes or culverts,

see Figures 5 (c), (d) and (e)

The tailwater depth T_w shall be determined from Paragraphs 4.1.6 and 4.1.7, and the headwater depth H_w from Paragraph 4.1.8.

4.1.6 Tailwater depth T_w (m) shall be calculated by an iterative process from the formula:

$$Q_c = A_f S^{1/2} R^{2/3} / n$$

where

Q_c = catchment surface water run-off or that portion arriving at the pipe or culvert (m³/s).

A_f = cross-sectional area of the flow immediately downstream of the pipe or culvert outlet (m²).

S = slope of the stream (vertical fall/horizontal distance) immediately downstream of the outlet.

R = hydraulic radius of the stream (m) = A_f/P .

P = wetted perimeter (m) of the stream flow.

n = Manning's 'n' (roughness coefficient). See Table 3.

4.1.7 Firstly a tailwater depth T_w (m) is assumed and, from knowledge of the stream cross-section, the corresponding values of A_f , P and R are determined. These values are then used in the above formula to calculate Q_c which is compared to the actual value of Q_c known to arrive at the pipe. If the calculated value of Q_c is less than the actual value then the assumed tailwater depth shall be increased and the value of Q_c recalculated. The procedure shall be repeated until such time as the tailwater depth T_w used gives two values of Q_c that agree.

If $T_w < D$ then T_w shall be this value or $(d_c + D)/2$ whichever is the greater, where:

d_c = critical depth (m) and is determined by Figures 8 and 9.

D = internal pipe diameter (m) for Figure 8.

B = culvert width (m) for Figure 9.

Figure 5: Pipe Flow Conditions for Inlet and Outlet Control
 Paragraphs 3.2.2, 4.1.1, 4.1.2, 4.1.4 and 4.1.5

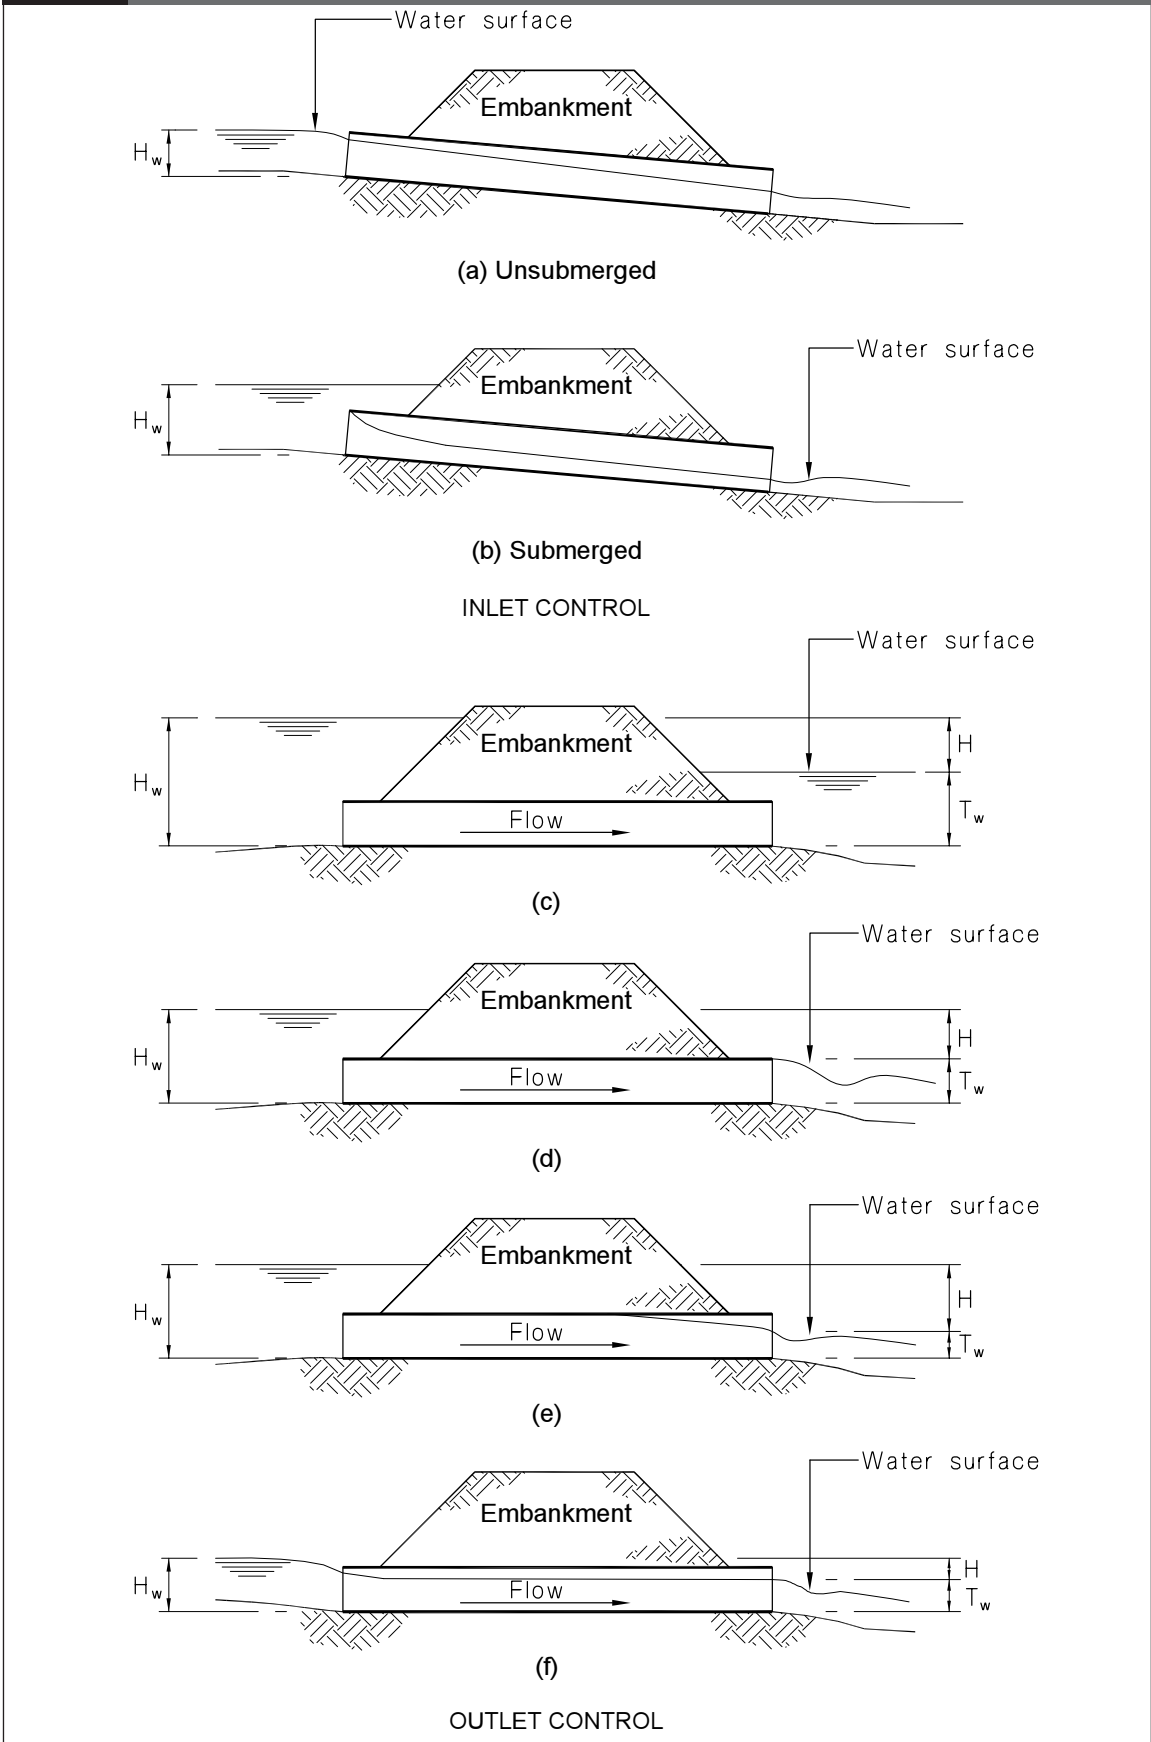


Figure 6: Headwater Depth for Circular Pipes
Paragraphs 3.2.3 a) and 4.1.4 a)



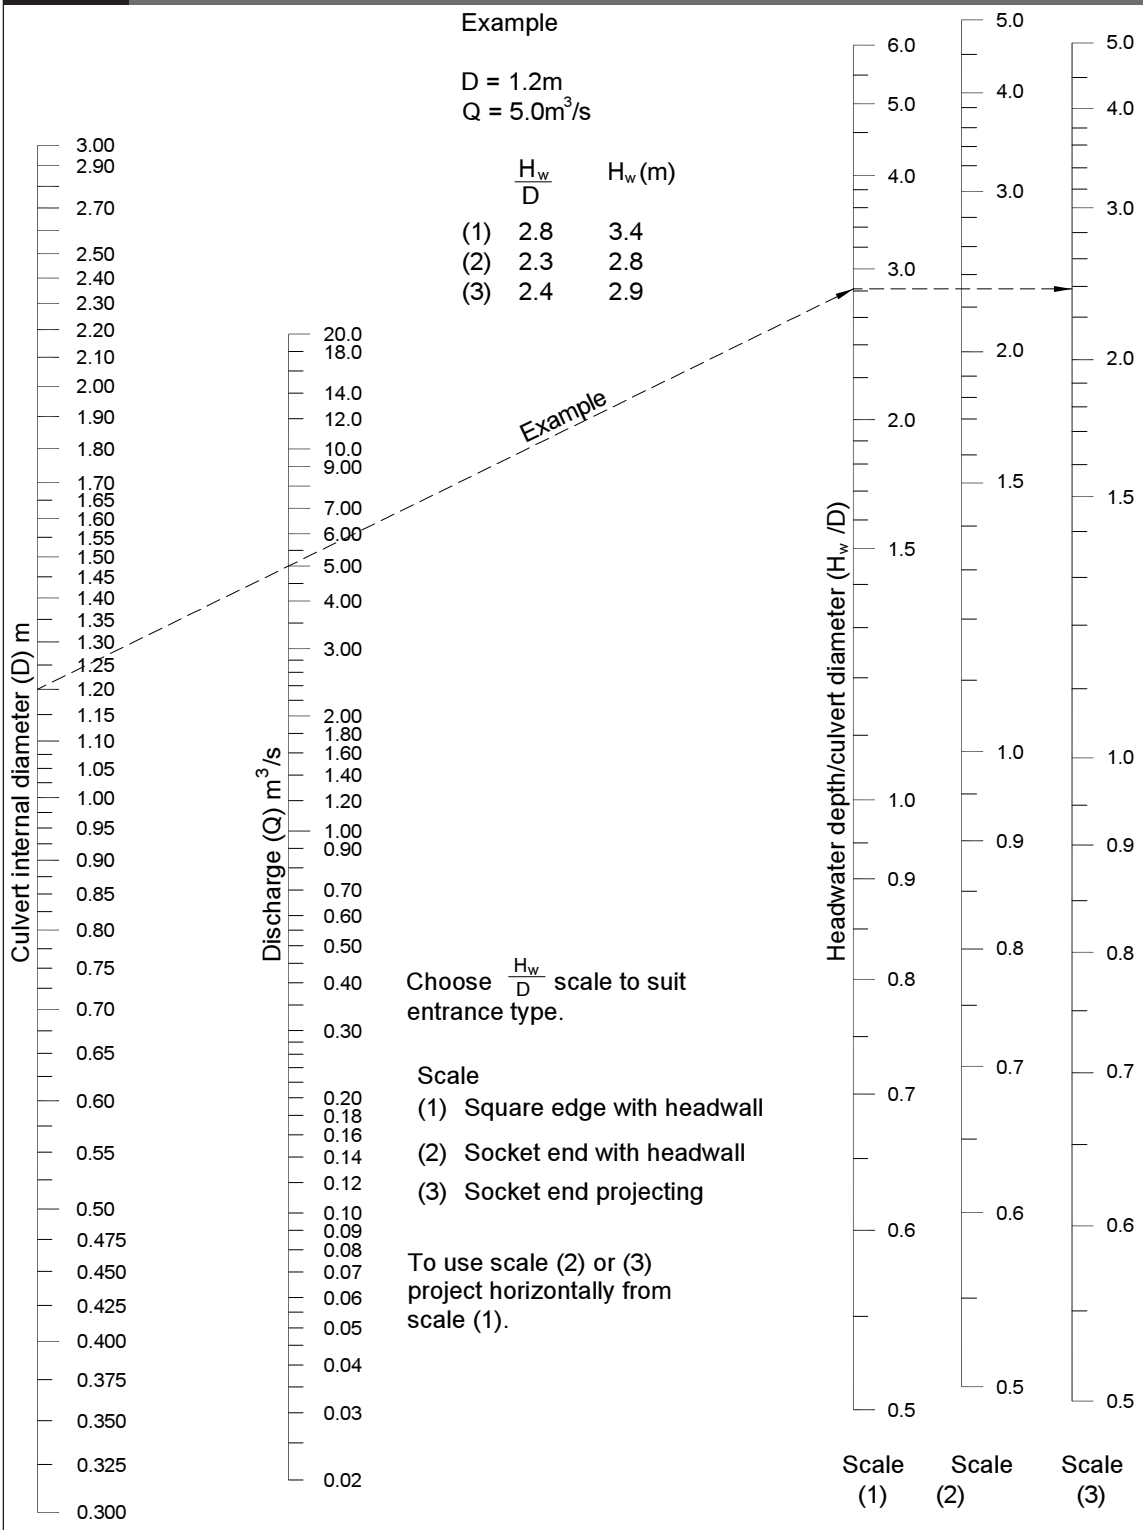


Figure 7: Headwater Depth for Box Culverts
 Paragraphs 3.2.3 b) and 4.1.4 b)

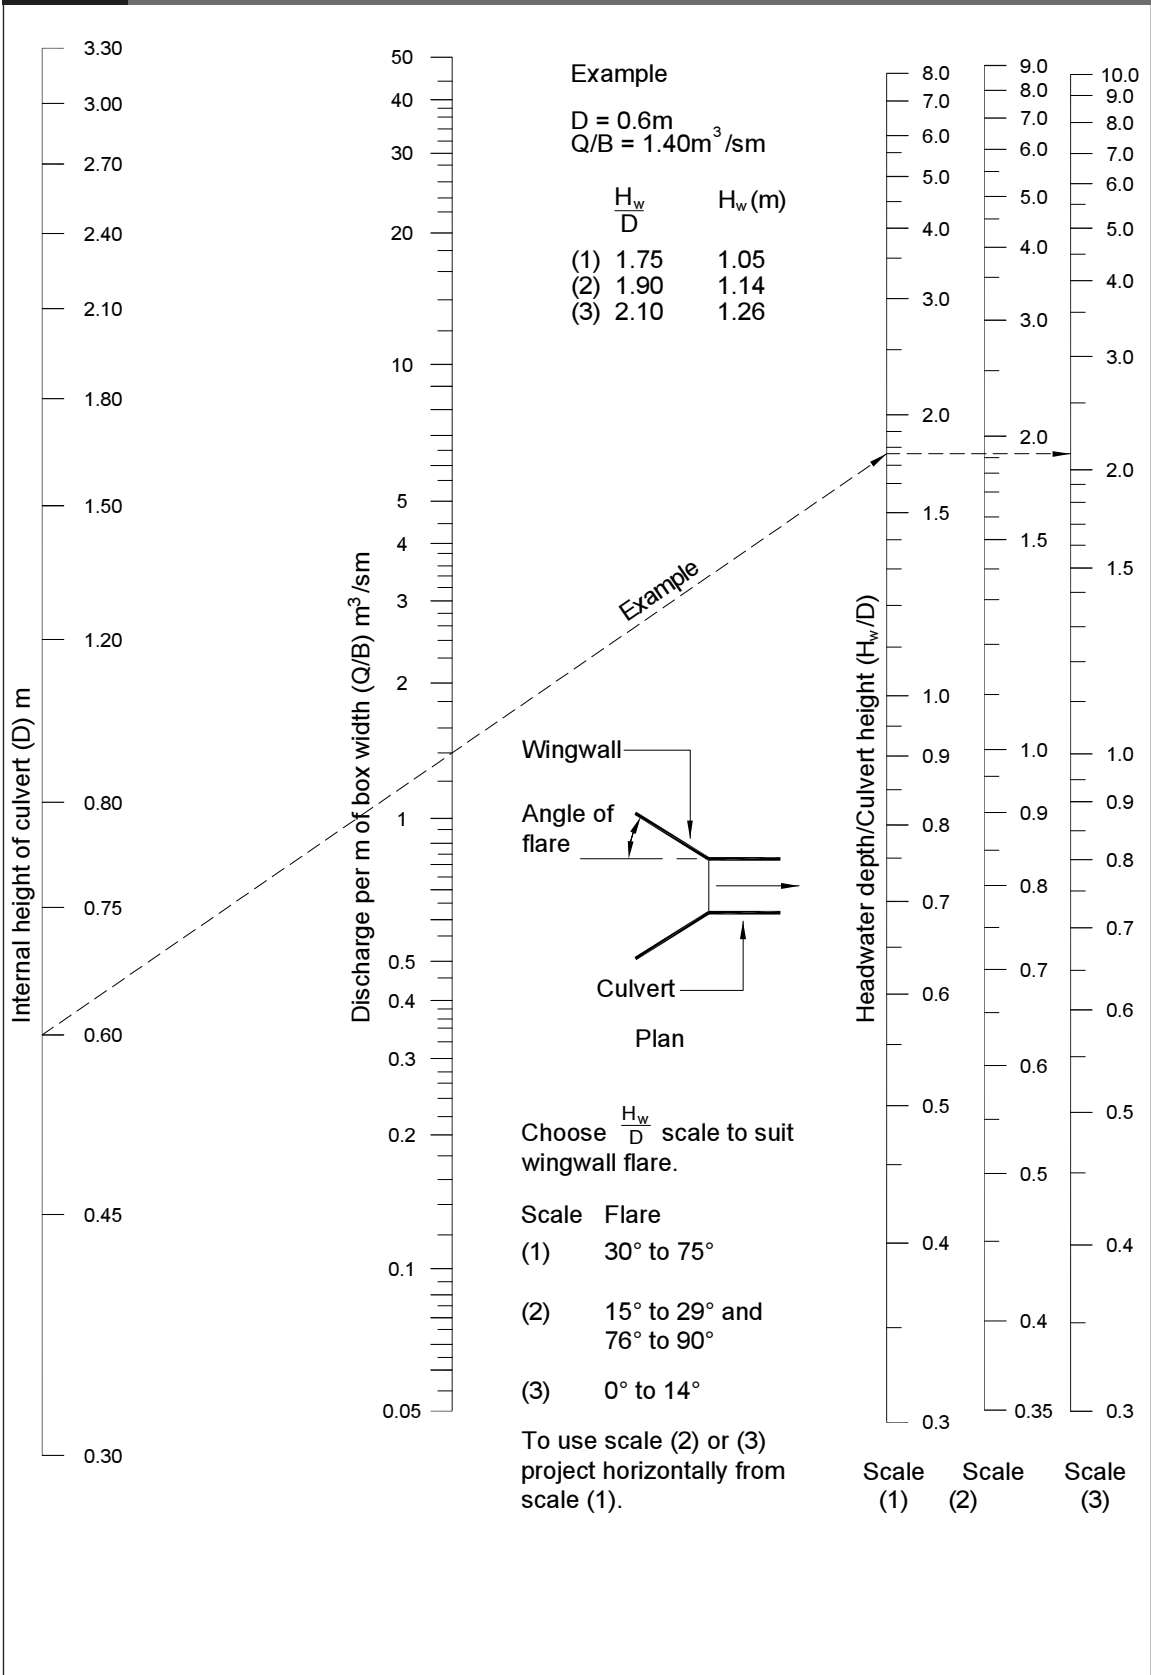

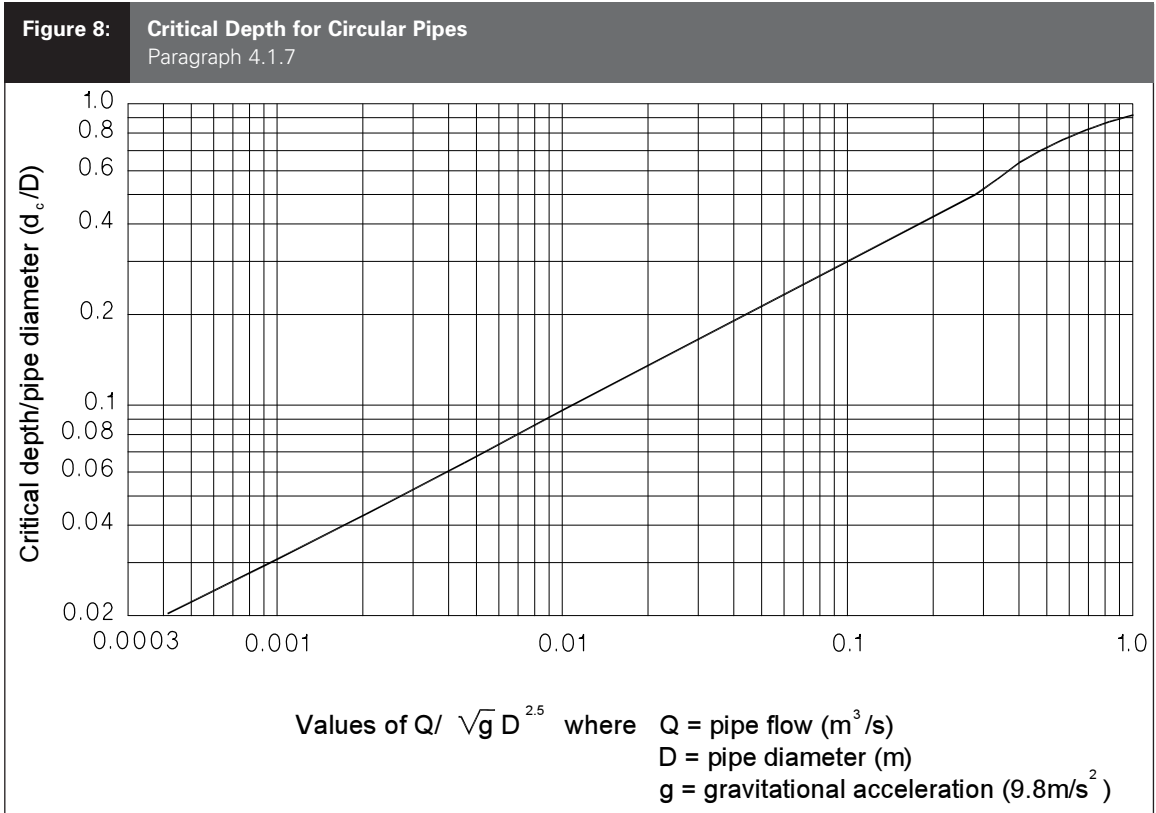

4.1.8 The headwater depth H_w (m) shall be calculated by:

$$H_w = H + T_w - LS, \text{ and}$$

$$H = v^2(1 + k_e)/2g + (Q_c n/R^{2/3} A_p)^2 L$$

where

T_w = tailwater depth (m).

H = downstream head (m).

L = length of the pipe or culvert (m).

S = slope of the pipe or culvert (vertical fall/horizontal distance) with the vertical fall being measured between the intake and outlet invert levels. If gravels or sand are present in the pipe or culvert then the surface of the gravel or sand shall be taken as the invert level.

v = flow velocity in the pipe or culvert (m/s).

k_e = entrance loss coefficient as given by Table 4.

Q_c = catchment *surface water* run-off or that portion arriving at the pipe (m^3/s).

n = Manning's 'n' (roughness coefficient) as given in Table 3.

R = hydraulic radius (m).


A_p = cross-sectional area of the pipe or culvert (m^2).

4.1.9 As an alternative to the formula given in Paragraph 4.1.8, Figures 10 and 11 may be used directly to determine downstream H applying the values of Manning's 'n' and k_e given in those Figures.

4.1.10 Determination of secondary flow quantity

The estimated water surface level, determined from H_w (m), is the actual water surface if all the *surface water* run-off Q_c (m^3/s) flows through the pipe or culvert. This level shall be compared to the ground levels upstream of the pipe intake to determine if a possible *secondary flow path* exists. If the ground level upstream of the intake is higher than the

Figure 9: Critical Depth for Box Culverts
Paragraph 4.1.7

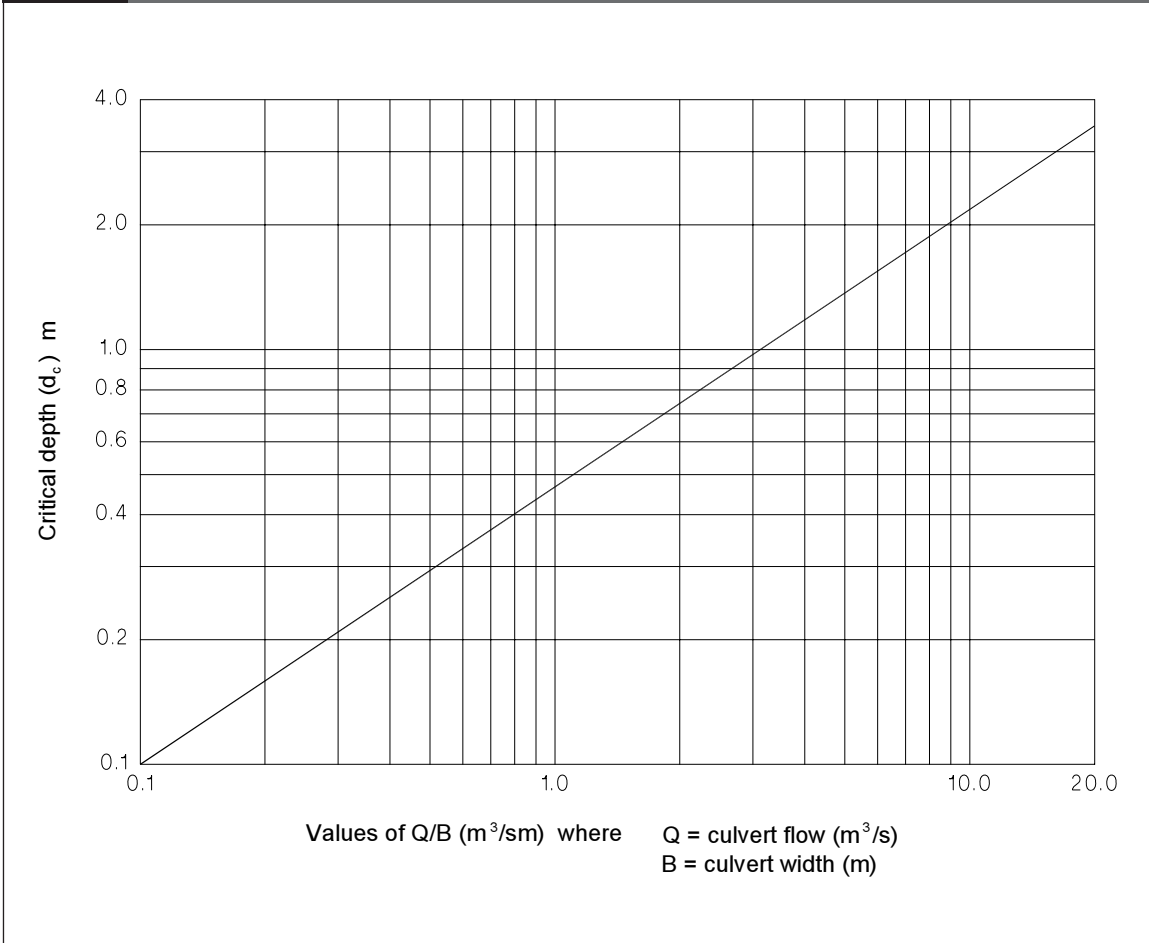

water surface level (H_w) no secondary flow will occur. If the water surface is higher than the ground level upstream of the intake and the ground contours provide a *secondary flow path* between the possible overflow point and the *building* site, an estimate of the secondary flow volume likely to arrive at the site shall be made using the formula:

$$Q_c = Q_p + Q_{sf}$$

where Q_p and Q_{sf} (m^3/s) are determined from an iterative process where:

Q_p = flow in the pipe or culvert determined from Paragraphs 4.1.4 and 4.1.5 using an assumed headwater surface level H_w which allows for secondary flow, and

Q_{sf} = the secondary flow down the *secondary flow path* corresponding to the assumed headwater surface level H_w . Q_{sf} shall be determined from Paragraph 4.1.11 provided there is no restriction downstream of the secondary flow overflow point which could cause a backwater effect on either Q_p or Q_{sf} capable of ponding water to a height sufficient to reach the level of H_w . Specific design is required where such restrictions occur.

If the summation of Q_p and Q_{sf} is less than Q_c then a higher H_w shall be used to recalculate Q_p and Q_{sf} . If it is greater than Q_c then a lower H_w shall be used to recalculate Q_p and Q_{sf} . The designer shall refine the water surface level H_w until $Q_c = Q_p + Q_{sf}$.

Table 4: Entrance Loss Coefficients
Paragraph 4.1.8

Design of entrance	Entrance loss coefficients k_e
Pipe culverts	
Pipe projecting from fill:	
square cut end	0.5
socket end	0.2
Headwall with or without wing walls	
square end	0.5
socket end	0.2
Pipe mitred to conform with fill slope	
precast end	0.5
field cut end	0.7
Box culverts	
No wing walls, headwall parallel to embankment	
square edge on three edges	0.5
three edges rounded to 1/12 of barrel dimensions	0.2
Wing walls at 30° to 75° to barrel	
square edge at crown	0.4
crown rounded to 1/12 of culvert height	0.2
Wing walls at 10° to 30° to barrel	
square edge to crown	0.5
Wing walls parallel (extension of sides)	
square edge at crown	0.7

4.1.11 The secondary flow Q_{sf} shall be determined from a) or b) as appropriate.

a) Where the flow over the secondary flow point operates as a weir (such as a flow over a culvert headwall, kerb, footpath, crown in the road, driveway entrance, etc.) then Q_{sf} shall be determined by:

$$Q_{sf} = 1.6 B H_{sf}^{3/2}$$

where

Q_{sf} = secondary flow (m^3/s).

B = width (metres) of the *secondary flow path* at the point of overflow over the weir, from the channel to the *secondary flow path*.

H_{sf} = secondary flow water depth (metres), being the difference between the assumed headwater surface level

H_w and the average ground level over width B , at the point of overflow into the *secondary flow path*.

b) Where the flow over the secondary flow point operates as a pipe or channel flow (such as directly down a side channel or pipe) then Q_{sf} shall be determined by:

$$Q_{sf} = A_{sf} R_{sf}^{2/3} S_{sf}^{1/2} n_{sf}^{-1}$$

where

Q_{sf} = secondary flow (m^3/s).

A_{sf} = cross-sectional area (m^2) of the flow down the secondary flow channel or pipe.

R_{sf} = hydraulic radius (m) = A_{sf} / P_{sf}

P_{sf} = wetted perimeter (m) of the cross-section of the secondary flow in the channel or pipe.

S_{sf} = slope of the ground (vertical fall/horizontal distance) along the *secondary flow path* at the overflow point.

n_{sf} = Manning's 'n' (roughness coefficient). See Table 3.

4.2 Secondary flow from an open water course upstream of the site

4.2.1 Where the surface run-off from a catchment at a possible overflow point Q_c is flowing at subcritical flow, i.e. where:

$$v_c \leq (gH_c)^{0.5}$$

where

v_c = velocity (m/s) in the stream at the possible overflow point.

H_c = depth of flow (m) in the stream at the possible overflow.

then an assessment of secondary flow Q_{sf} shall be made by the procedure set out below. If the surface run-off from the catchment, at the possible overflow point Q_c is flowing at super critical flow (i.e. $v_c > (gH_c)^{0.5}$) then specific design shall be used to assess Q_{sf} .

Continued on page 27

Figure 10: Downstream Head for Circular Pipe Culverts
Paragraph 4.1.9


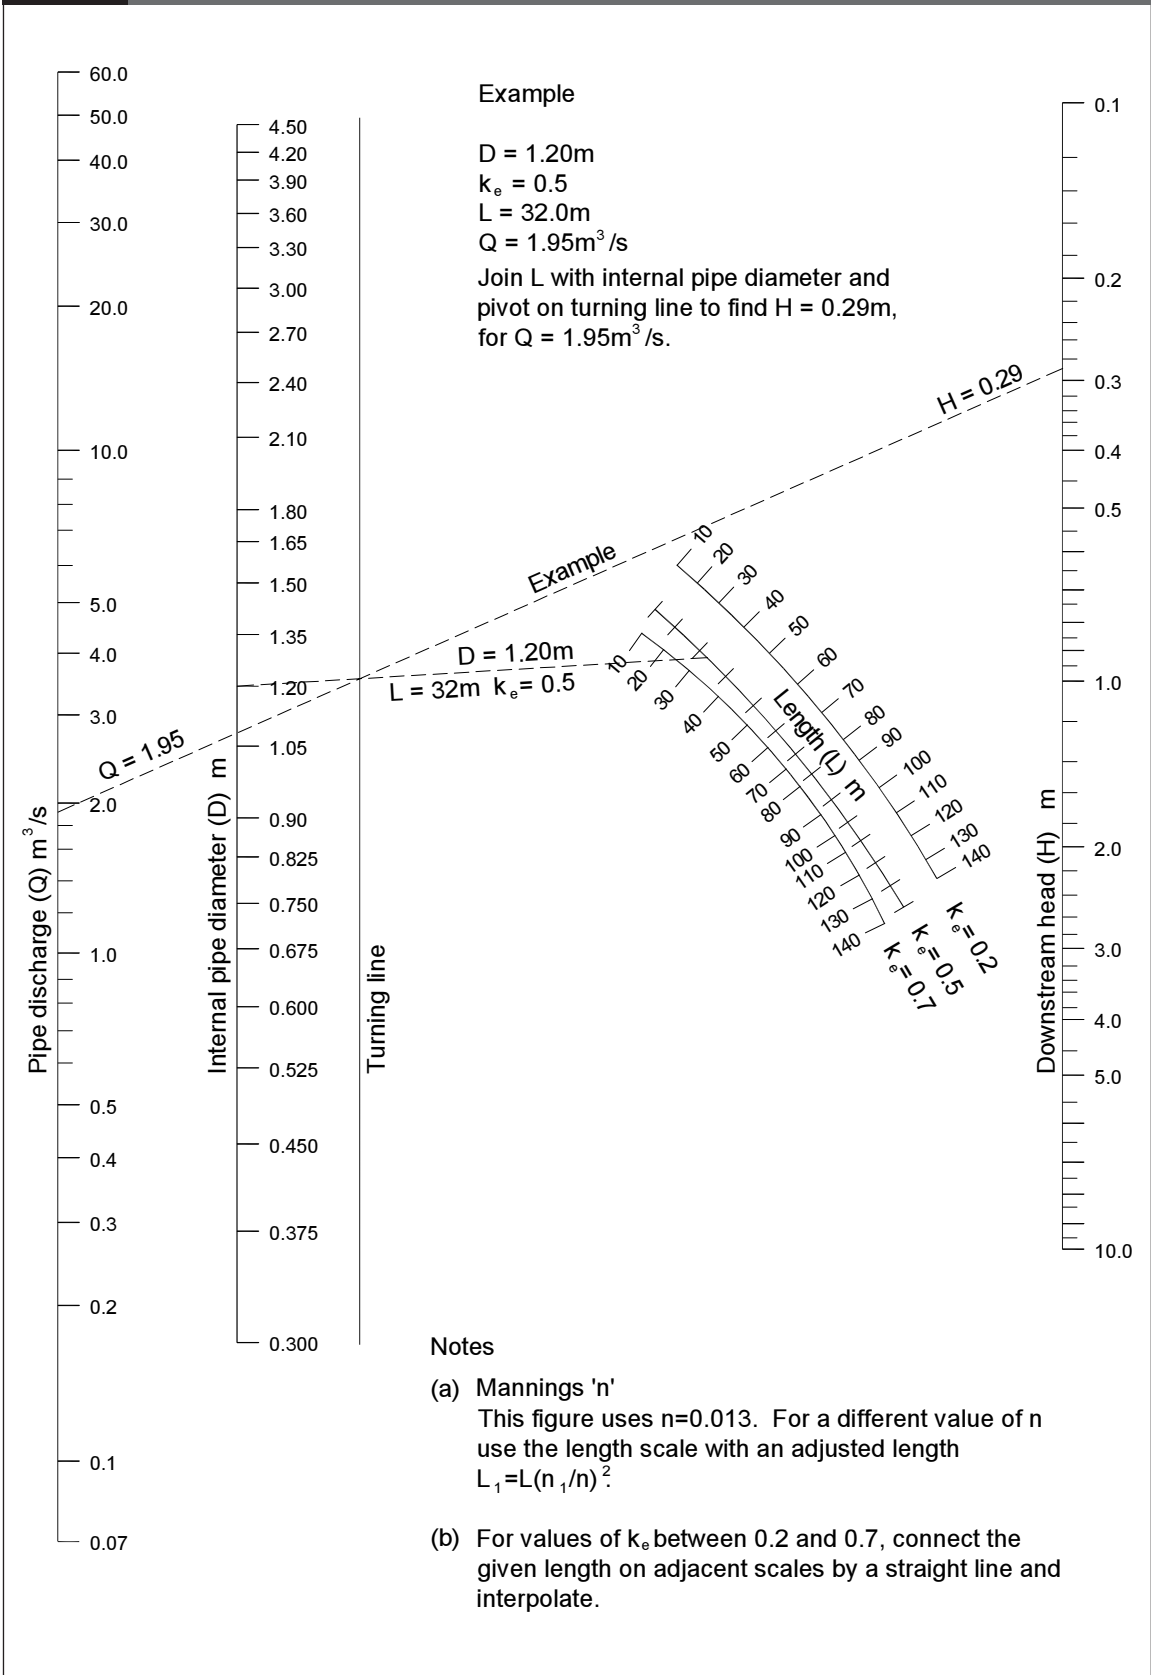


Figure 11: Downstream Head for Box Culverts
Paragraph 4.1.9

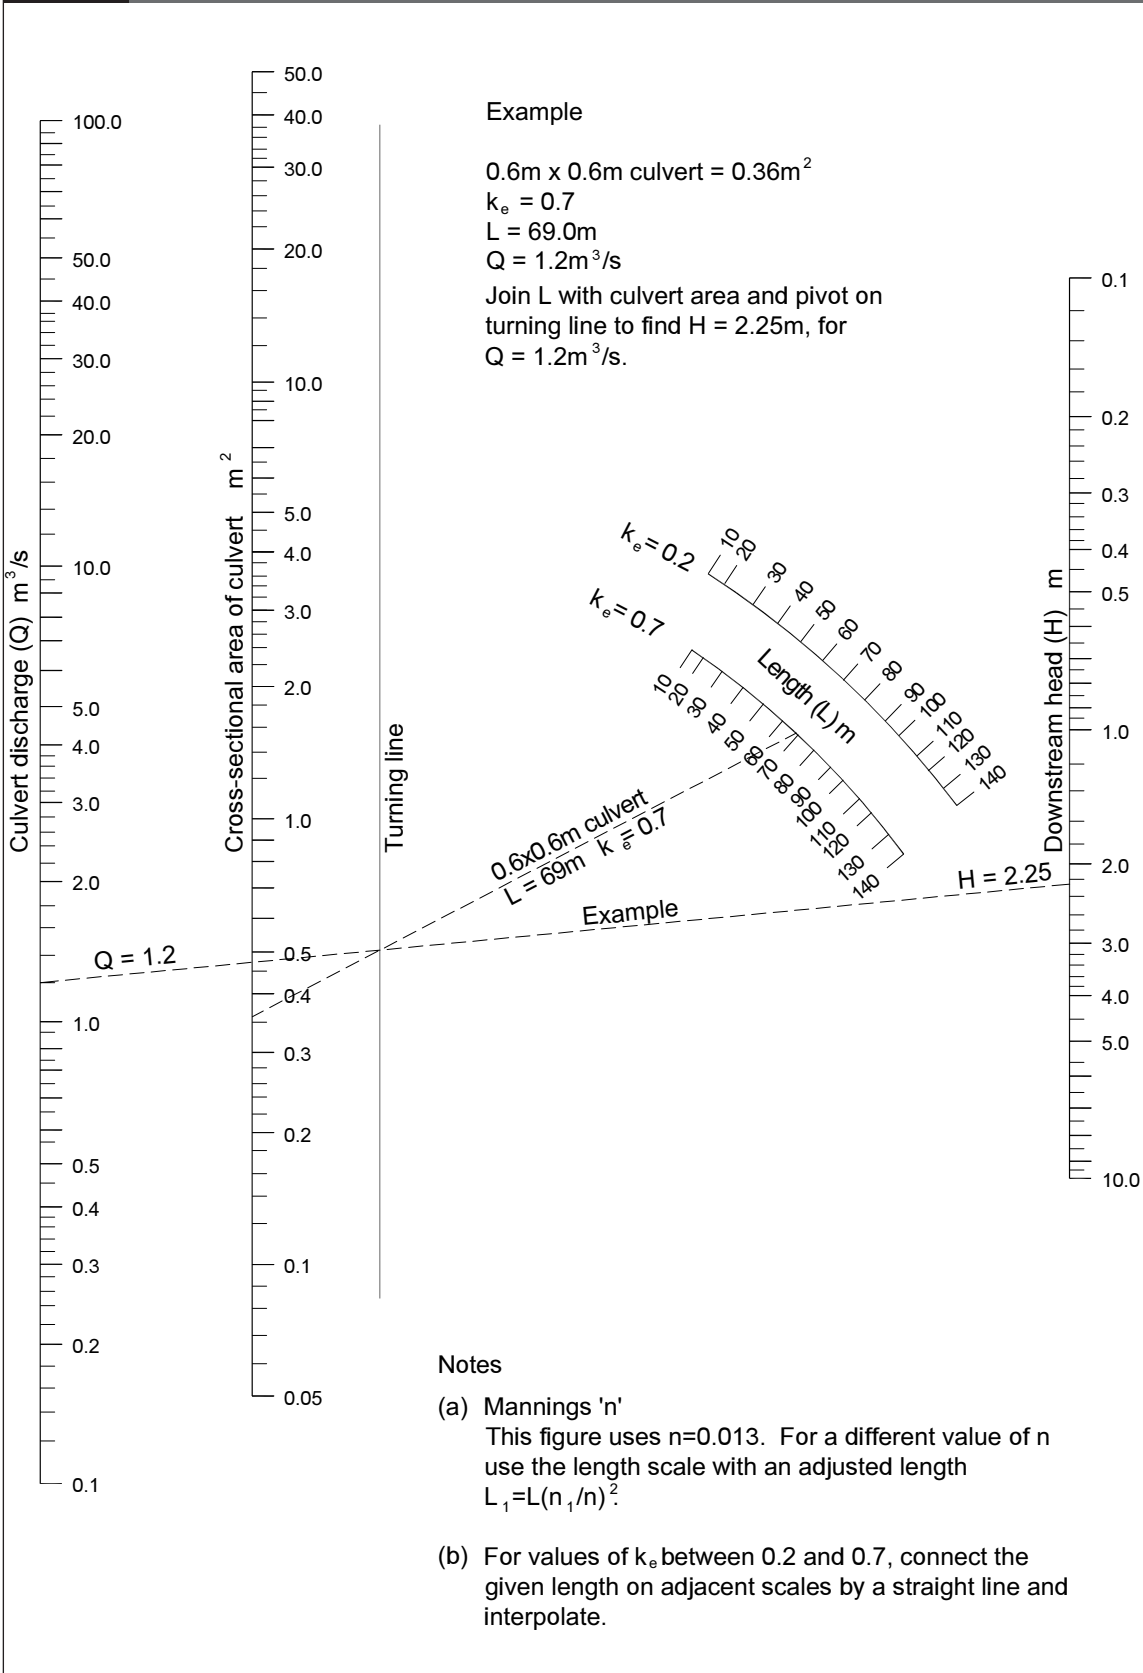

Secondary flow from an open water course upstream of the site shall be determined by an iterative process similar to that described in Paragraph 4.1.10 for pipes and culverts but using the formula:

$$Q_c = Q_{\text{strm}} + Q_{\text{sf}}$$

where

Q_c = surface run-off from catchment upstream of possible overflow point (m^3/s),

Q_{strm} = that portion of surface water run-off (m^3/s) flow down the stream channel downstream of the possible overflow point, and

$$Q_{\text{strm}} = R_{\text{strm}}^{2/3} S_{\text{strm}}^{1/2} n_{\text{strm}}^{-1} A_{\text{strm}}$$

where R_{strm} and A_{strm} are determined from an assumed water surface and

R_{strm} = hydraulic radius of stream (m) downstream of the possible overflow point.

S_{strm} = slope of stream (vertical fall/horizontal distance) downstream of the possible overflow point.

n_{strm} = Manning's 'n' (roughness coefficient). See Table 3.

A_{strm} = cross-sectional area of the stream (m^2), and

$$Q_{\text{sf}} = R_{\text{sf}}^{2/3} S_{\text{sf}}^{1/2} n_{\text{sf}}^{-1} A_{\text{sf}}$$

where R_{sf} and A_{sf} are determined from the secondary flow depth being the difference between the assumed water surface and the ground level at the point of overflow into the *secondary flow path*.

The designer shall refine the level of water surface until $Q_c = Q_{\text{strm}} + Q_{\text{sf}}$.

4.3 Secondary flow from site to downstream drainage system

4.3.1 The secondary flow estimated to arrive on the site shall be directed into the *surface water* drainage system designed for the site. The height of the secondary flow shall be used as a basis for determining the *building* floor level necessary to comply with the requirements of NZBC E1.3.2.

The level of the floor shall be set at the height of the secondary flow plus an allowance for freeboard. The freeboard shall be:

- 500 mm where *surface water* has a depth of 100 mm or more and extends from the *building* directly to a road or car park, other than a car park for a single dwelling.
- 150 mm for all other cases.

COMMENT:

The 500 mm freeboard allows for waves generated by vehicles. Such waves will not be sustained unless there is at least 100 mm depth of water and an unobstructed path from the point where the wave is generated to the *building*.

5.0 Energy Losses Through Structures

5.0.1 Hydraulic design shall make allowance for energy losses at *access chamber* structures where a change in direction of the flow occurs. An additional fall shall be provided through the *access chamber* to allow for these losses. This fall H_L (m) is in addition to the fall produced by the gradient of the pipe line, and shall be calculated using the formula:

$$H_L = Kv^2/2g$$

where

K = energy loss coefficient for change in direction determined from Figure 12.

v = flow velocity (m/s).


g = gravitational acceleration = 9.8 m/s^2 .

5.0.2 In cases where a reduction in *drain* size is justified by a large increase in gradient, an additional head loss of $0.5 v_e^2/2g$ shall be allowed for (v_e = exit velocity). Such reductions in size are only permissible where the exit pipe has an internal diameter of 300 mm or greater.

6.0 Minimum Velocity

6.0.1 A *drain*, shall have a minimum flow velocity of 0.6 m/s when *sumps* are incorporated and 0.9 m/s when no *sumps* are used.

Figure 12: Energy Loss Coefficient
Paragraph 5.0.1

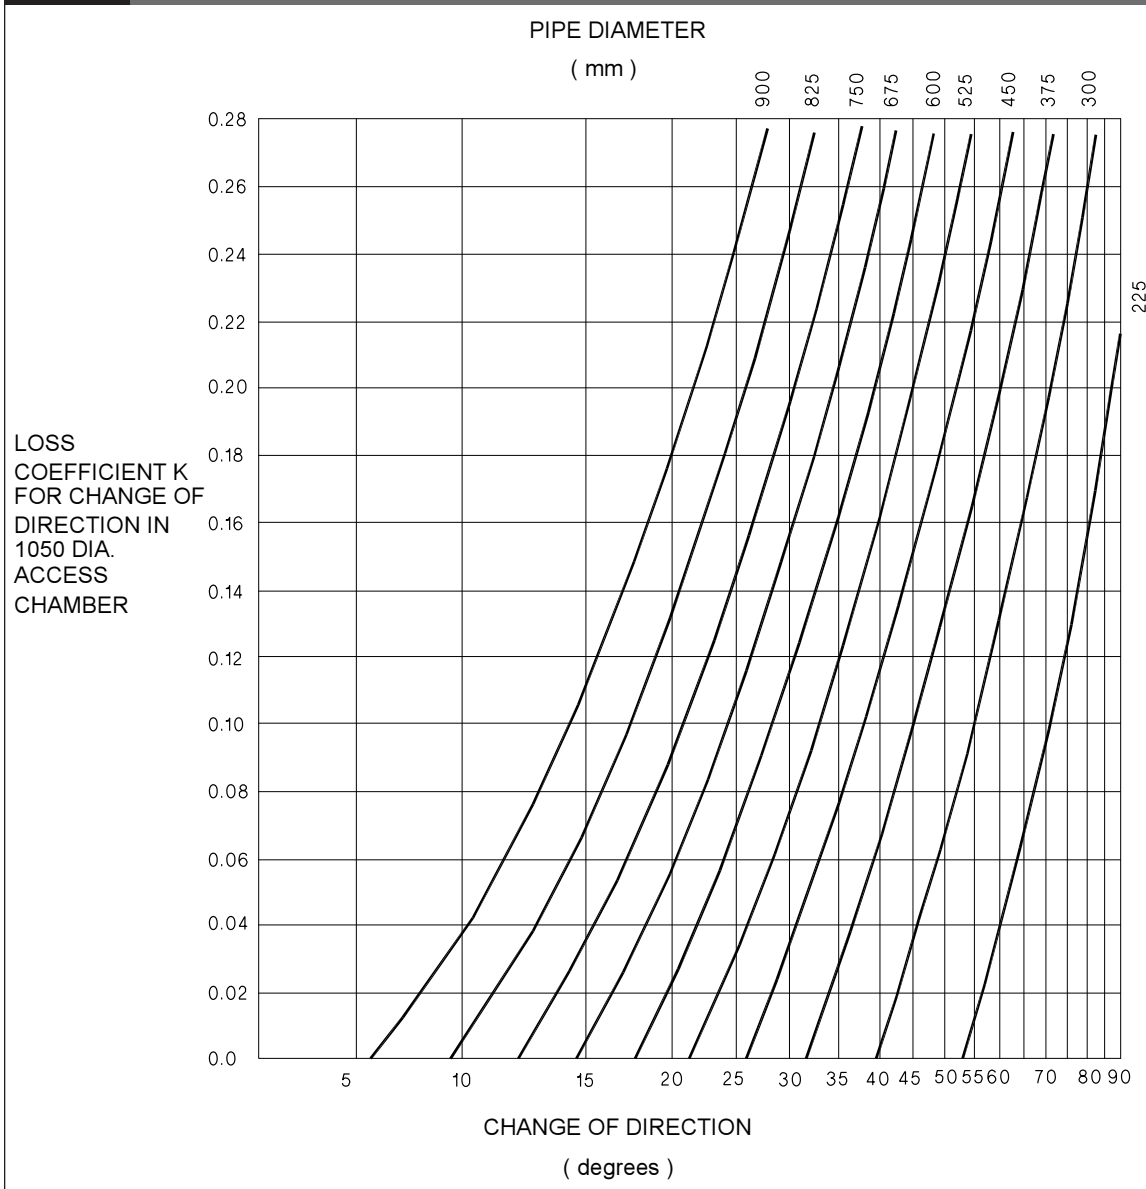

7.0 Outfall Protection

7.0.1 Unless more stringent requirements are imposed by the *network utility operator* the following shall apply to the flow discharging from the site into the *outfall*:

- a) The exiting velocity shall not exceed the values given in Table 5, and
- b) Where the *outfall* is a pipe, culvert or stream the volume discharged shall not exceed 20% of the flow in the *outfall* immediately upstream of the discharge point.

COMMENT:

- 1. The *outfall*, be it a pipe, culvert, stream, lake or the sea, needs to be protected from erosion or scour to meet the requirements of Clause E1.3.3 (e).
- 2. If exit velocities exceed those given in Table 5 protective structures to dissipate the energy and reduce the velocities are required. These require specific design which is outside the scope of this document.
- 3. Discharge to some *outfalls* will require a resource management consent.

Table 5: Maximum Exit Velocities of Flow from Pipes and Culverts Discharging to Outfalls Paragraph 7.0.1

Outfall material	Velocity m/s
Precast concrete pipes to NZS 3107	8.0
Precast concrete culverts	8.0
In-situ concrete and hard packed rock (300 mm minimum)	6.0
Beaching or boulders (250 mm minimum)	5.0
Stones (100-150 mm)	2.5 – 3.0
Grass covered surfaces	1.8
Stiff, sandy clay	1.3 – 1.5
Coarse gravel	1.3 – 1.8
Coarse sand	0.5 – 0.7
Fine sand	0.2 – 0.5

8.0 Drain Leakage Tests

8.0.1 The materials and workmanship used in *surface water drains* shall pass one of the following tests:

- a) Water test.
- b) Low pressure air test.
- c) High pressure air test.

8.0.2 Regardless of test method the pipeline to be tested shall be sealed with suitably restrained plugs (at both ends and at all branch connections) and, where the pipe material is porous (such as ceramic or concrete), it shall be soaked for 24 hours prior to testing.

COMMENT:

Soaking is necessary as porous pipes can absorb water or transmit air through their walls.

8.1 Water test

- a) Fill pipe with water, ensuring all air is expelled.
- b) Top up water to test head level. The minimum head shall be 1.5 m above the top of the pipe or ground water level whichever is the higher. The maximum head at the lower end of the pipeline shall not exceed 6.0 m.
- c) Leave for 30 minutes then measure water loss.
- d) The pipeline is acceptable if water loss does not exceed 2 ml per hour, per mm of internal diameter, per m of pipeline length.

8.2 Low pressure air test

- a) Introduce air to the pipeline till a pressure of 300 mm water gauge is reached. (This may be measured by a manometer such as a 'U' tube, connected to the system.)
- b) Wait until the air temperature is uniform. (Indicated by the pressure remaining steady.)
- c) Disconnect the air supply.
- d) Measure pressure drop after 5 minutes.
- e) The pipeline is acceptable if the pressure drop does not exceed 50 mm.

COMMENT:

1. The low pressure air test is highly susceptible to temperature fluctuations during the test period. A 1°C change during the 5 minute test period will cause a pressure change of 30 mm water gauge or 60% of the permitted change.
2. Failure to soak ceramic and concrete pipes can cause highly variable results.

8.3 High pressure air test

- a) Pressurise pipeline to 25 kPa.
- b) Wait at least 2 minutes to ensure temperature stabilisation.
- c) Disconnect air supply.
- d) Measure the time taken (minutes) for the pressure to drop to 17 kPa.
- e) The pipeline is acceptable if the time taken exceeds that given for the appropriate pipe size in Table 6.

Table 6: Time For Pressure Drop Versus Internal Pipe Diameter
Paragraph 8.3 e)

Internal pipe diameter (mm)	Time for permissible pressure drop (minutes)
90	3
100	3
150	4
225	6

9.0 Disposal to Soak Pit

9.0.1 Where the collected *surface water* is to be discharged to a soak pit, the suitability of the natural ground to receive and dispose of the water without causing damage or nuisance to neighbouring property, shall be demonstrated to the satisfaction of the *territorial authority*.

COMMENT:

Means of demonstrating the suitability of the ground are outside of the scope of this Verification Method. Disposal of *surface water* to a soak pit may also require a resource management consent.

9.0.2 Field testing of soakage shall be carried out as follows:

- a) Bore test holes of 100 mm to 150 mm diameter to the depth of the proposed soak pit. If groundwater is encountered in the bore test hole then this depth shall be taken as the depth of the soak pit.
- b) Fill the hole with water and maintain full for at least 4 hours, (unless the soakage is so great that the hole completely drains in a short time).
- c) Fill the hole with water to within 750 mm of ground level, and record the drop in water level against time, at intervals of no greater than 30 minutes, until the hole is almost empty, or over 4 hours, whichever is the shortest.
- d) Plot the drop in water level against time on a graph, and the soakage rate in mm/hr is determined from the minimum slope of the curve. If there is a marked decrease in soakage rate as the hole becomes nearly empty, the lower rates may be discarded and the value closer to the average can be adopted.

9.0.3 The soak pit shall be designed utilising soakage and storage in accordance with 9.0.5 and 9.0.6 to ensure that *surface water* is discharged without overflowing. The rainfall intensity used in the design of the soak pit shall be that of an event having a duration of 1 hour and a 10% probability of occurring annually. Either local rainfall intensity curves produced by the *territorial authority* or rainfall frequency duration information produced by NIWA shall be used to determine the rainfall intensity.

COMMENT:

This Verification Method does not cover the design of soak pits with overflows discharging to *outfalls*. Such soak pits are often provided to retain water until peak flows in the *outfall* have passed and it is normally considered sufficient to design them for an event having a 10 minute duration and a 10% probability of occurring annually.

9.0.4 The soak pit shall comprise either a rock filled hole (see Figure 13 (a)) or a lined chamber (see Figure 13 (b)). Both of these options shall be enclosed in filter cloth

complying with AS 3706.1. The filter cloth shall have a mass per unit area of 140 grams/m² and a minimum thickness of 0.45 mm.

9.0.5 The volume of storage required in the soak pit, V_{stor} (m³), shall be calculated by:

$$V_{stor} = R_c - V_{soak}$$

where

R_c = run-off discharged from catchment to soak pit in 1 hour (m³).

V_{soak} = volume disposed of by soakage in 1 hour (m³).

and

$$R_c = 10CIA$$

where

C = run-off coefficient (see Table 1).

I = rainfall intensity (mm/hr) based on 1 hour duration of an event having a 10% probability of occurring annually.

Amend 5
Jul 2001 |

A = area (hectares) of the catchment discharging to the soak pit.

and

$$V_{soak} = A_{sp}S_r/1000$$

where

A_{sp} = area of the base of the soak pit (m²).


S_r = soakage rate (mm/hr) determined from 9.0.2.

COMMENT:


Generally where the test results show a soakage rate of greater than 500 mm/hour, soakage rather than storage will be the main mechanism to remove the water. Where the soakage rate is significantly less than 500 mm/hour, storage will become the dominant factor. Intermediate soakage rates will require a design utilising both in the proportions necessary to ensure the water will dissipate before it overflows from the pit.

9.0.6 Where the soak pit comprises a rock filled hole (see Figure 13 (a)) then the volume available for storage, V_{stor} , shall be taken as 0.38 times the volume of the hole.

Figure 13: Soak Pit for Surface Water Disposal
Paragraph 9.0.4

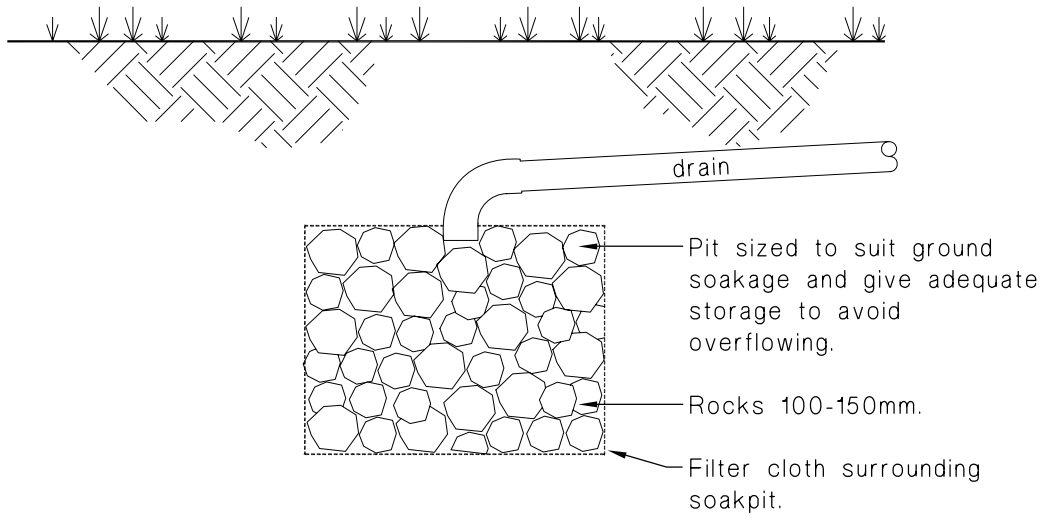

(a) Rock soak pit

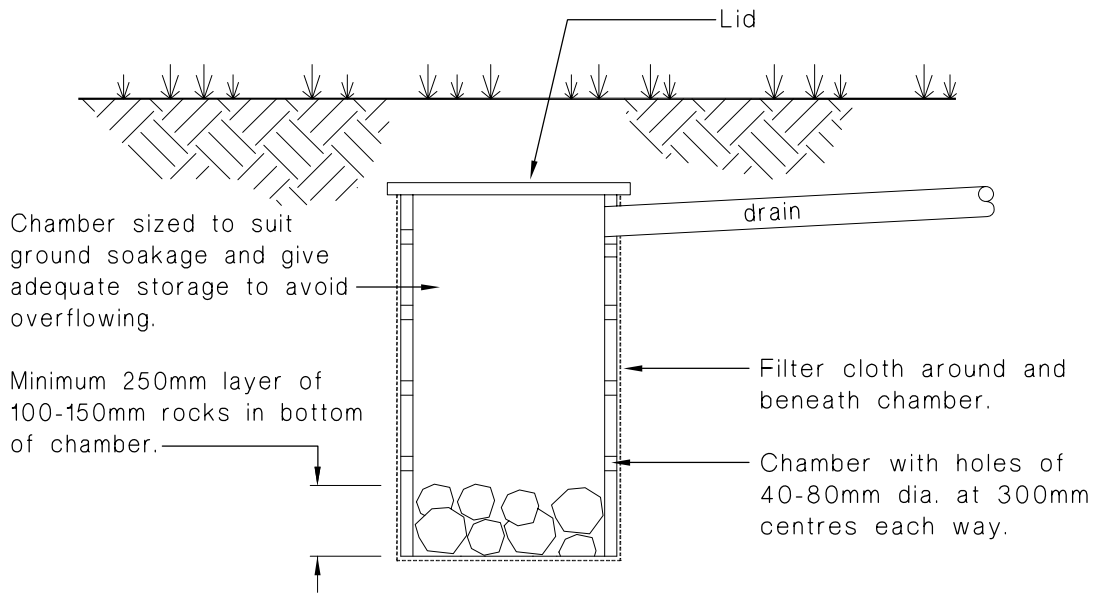

(b) Chamber soak pit

Acceptable Solution E1/AS1

1.0 Limitations of the Solution

1.0.1 This Acceptable Solution is limited to *buildings* and *sitework* having a catchment area of no more than 0.25 hectares and which are:

- a) Free from a history of flooding,
- b) Not adjacent to a watercourse,
- c) Not located in low lying area, and
- d) Not located in a *secondary flow path*.



COMMENT:

Boundary fences and other site development must not significantly hamper the flow of *surface water* from the site.

2.0 Minimum Acceptable Floor Level

2.0.1 Suspended floors and slabs on ground shall be at least 150 mm above the finished level of the surrounding ground immediately adjacent to the *building*, and:

- a) For sites level with or above the road, no less than 150 mm above the road crown on at least one cross-section through the *building* and roadway (see Figure 1).
- b) For sites below the road, no less than 150 mm above the lowest point on the site boundary (see Figure 2).

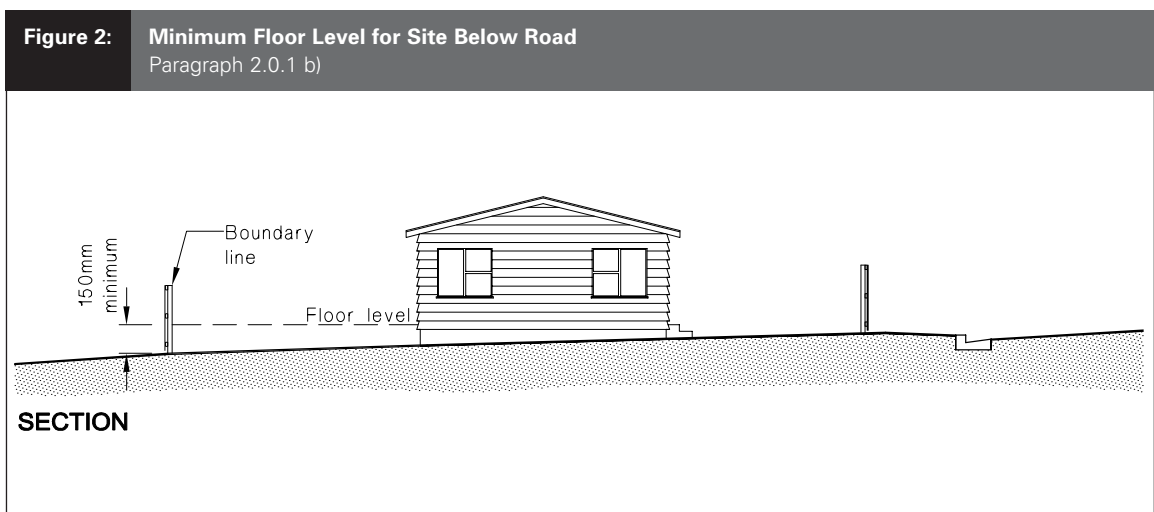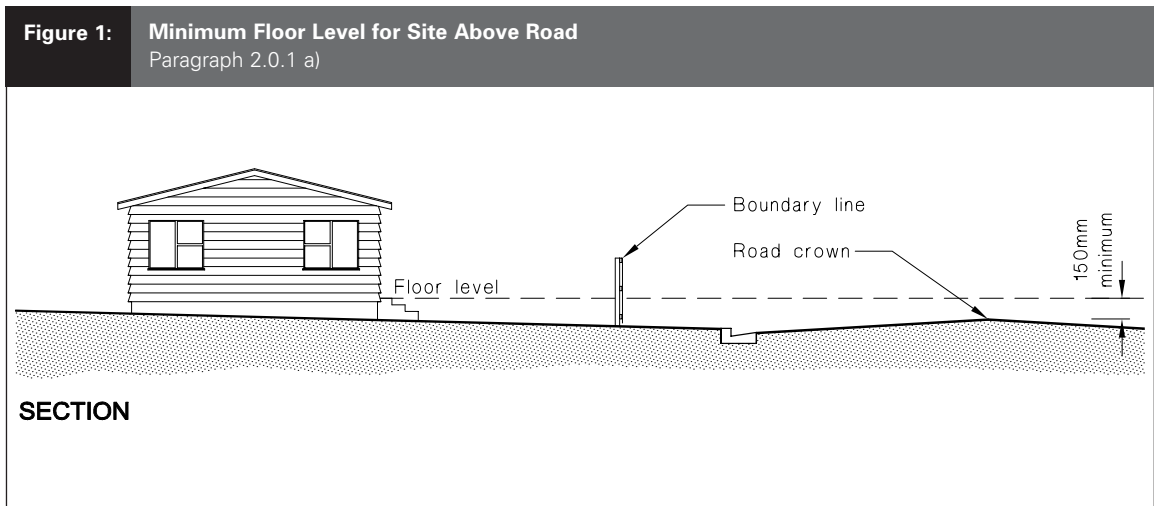

3.0 Drainage System Materials and Construction

3.1 Materials

3.1.1 Pipe materials shall comply with the standards given in Table 1.

Concrete	NZS 3107
Ceramic	NZS 3302
Vitrified clay	AS 1741
Steel	NZS 4442
Ductile iron	AS 2280
uPVC	NZS 7649 or AS 1254
HDPE	NZS 7604
ABS	NZS 7609

3.2 Sizing of drains

3.2.1 *Drains* shall be of sufficient size and gradient to transport *surface water* from the site, and be capable of handling the rainfall calculated to fall on roof and paved areas of the site during a storm with a 10% probability of occurring annually. No *drain* shall have an internal diameter of less than 85 mm.

3.2.2 Figure 3 provides a method for selecting the correct pipe size for a calculated modified catchment area, given as:

Modified catchment area = 0.01 AI,

where

- A = area being drained comprising plan roof area (m²) plus paved area (m²). Paved area includes paving blocks, concrete, asphalt or metallated surfaces.
- I = rainfall intensity for a storm with a 10% probability of occurring annually and a 10 minute duration (mm/hr).

The rainfall intensity (I) shall be obtained from the *territorial authority*. Where the *territorial authority* does not have this information the rainfall intensity shall be determined by interpolation of the figures in Appendix A.

3.2.3 The modified catchment area method is only suitable for the combination of pipe sizes, gradients and areas indicated in Figure 3. For other combinations specific design is required.

3.3 Alignment and gradient of drains

3.3.1 *Drains* shall be laid on a uniform line and gradient between points of access (see Paragraph 3.7). The change in direction of a *drain* shall not exceed 90° at any point, and where practical should be kept to less than 45° as illustrated in Figure 4.

3.3.2 Where two *drains* intersect, the directions of flow as shown in Figure 5 shall be at an angle of 60° or less.

3.4 Minimum gradients

3.4.1 Minimum acceptable gradients for *surface water drains* are given in Table 2.

Drain internal diameter	Minimum gradient
85 mm	1 in 90
100 mm	1 in 120
150 mm	1 in 200
225 mm	1 in 350

3.4.2 Restricted fall to outlet

Where the *surface water sewer*, road channel or other *outfall* is at too high a level to allow the gradient required by Table 2, the bubble-up chamber system shown in Figures 6 and 7 may be used provided that:


- a) The ground level adjacent to any downpipe discharging to the bubble-up chamber is at least 150 mm higher than the level of the top of the chamber outlet.
- b) The connections between the *drain* and downpipes are sealed.
- c) The total chamber depth does not exceed 1.0 m.

Continued on page 36

Amend 1
Sep 1993


Amend 1
Sep 1993



Figure 3: Sizing of Surface Water Drains
Paragraphs 3.2.2 and 3.2.3

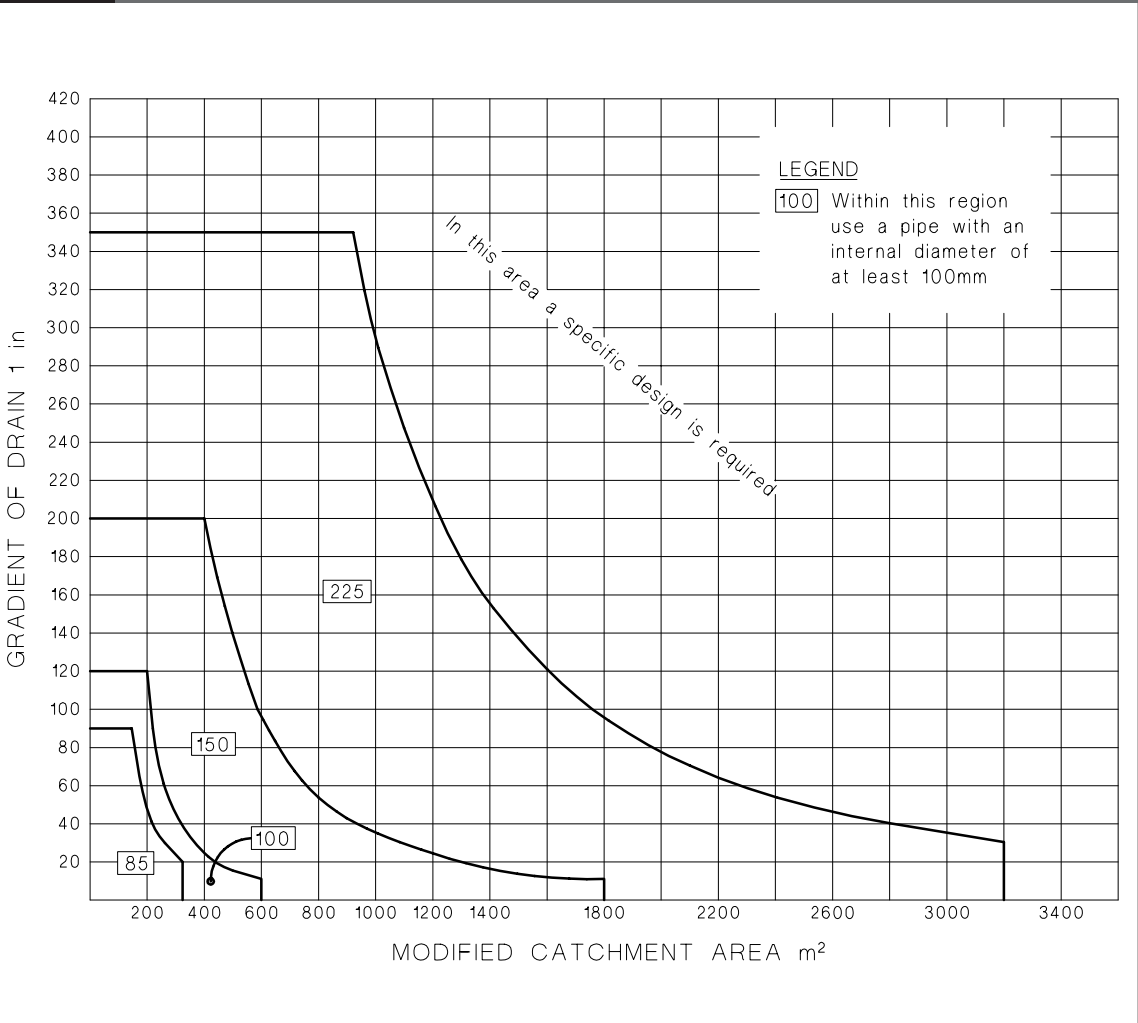

Amend 1
Sep 1993

Figure 4: Changes of Direction
Paragraph 3.3.1

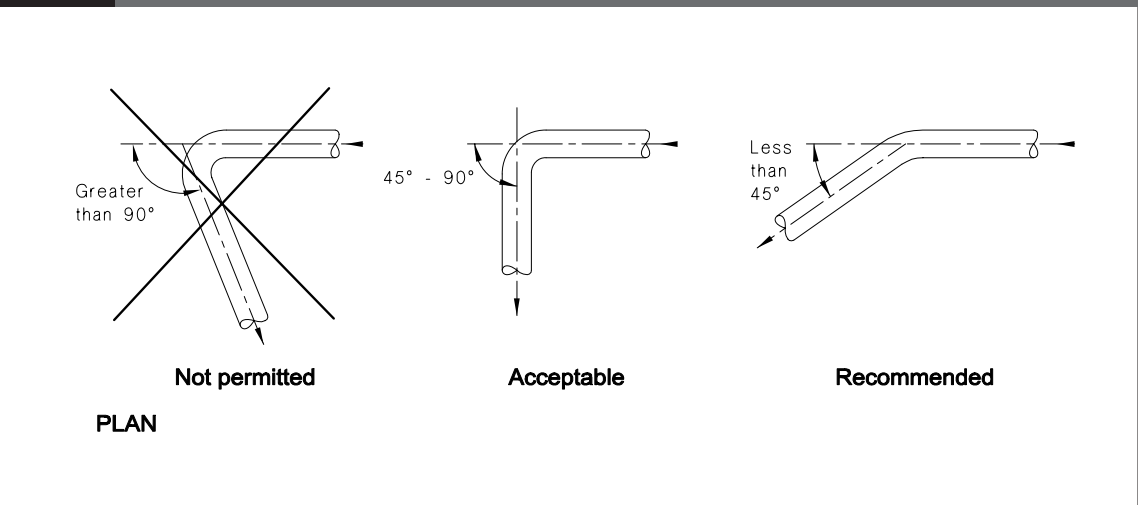

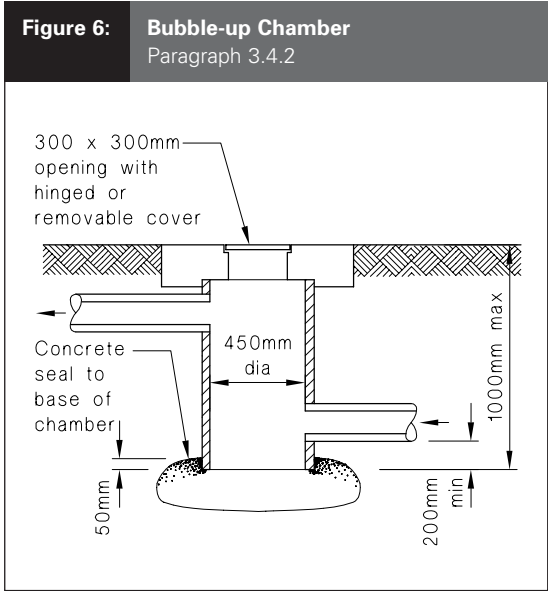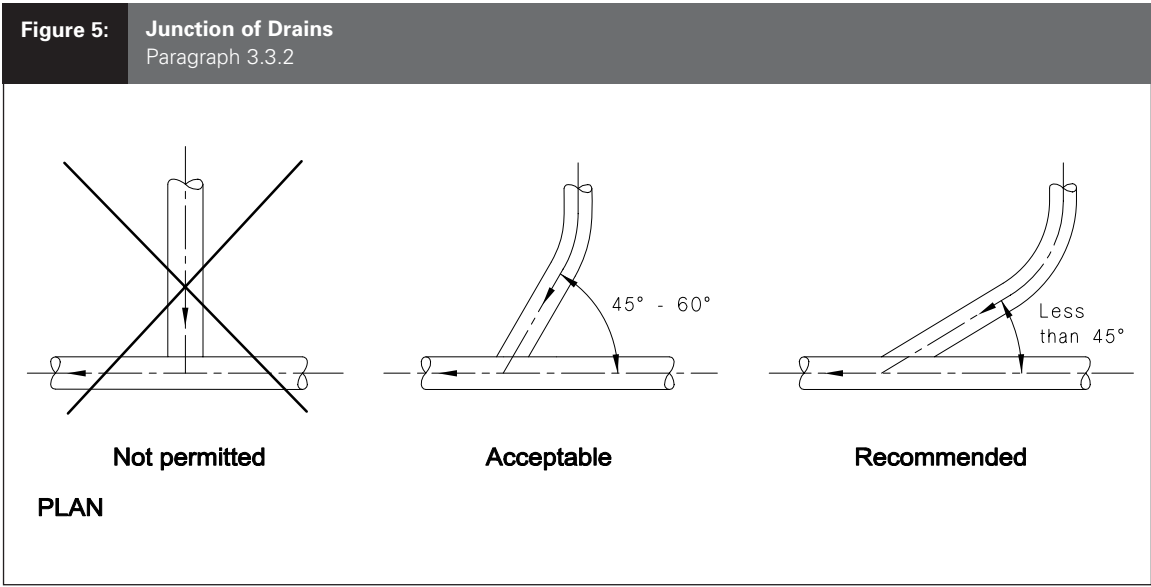

COMMENT:
The bubble-up chamber allows the water to be discharged through pipes laid at the allowable minimum gradients, and for the convenient collection and removal of any silts or debris which might enter the system.

3.5 Jointing of drains

3.5.1 All joints in *drains* shall be watertight and prevent the infiltration of groundwater and the intrusion of tree roots.

3.5.2 Acceptable jointing methods and the relevant standards are given in Table 3. Jointing of *drains* shall be subject to the tests called for in Paragraph 3.8.

3.5.3 Where a *drain* consists of concrete, ceramic, vitrified clay or rubber ring jointed steel or uPVC, a flexible joint shall be installed within 225 mm of the outside wall of any *access chamber* or *inspection chamber*, but outside the line of the base (see Figures 11 and 12).

COMMENT:
This allows for differential settlement between the *access chamber*, or the *inspection chamber*, and the pipeline while minimizing damage to the pipeline.

3.6 Surface water inlets to drains

3.6.1 All *surface water*, except that collected directly from a roof, shall enter the *drain* via a *sump* which has:

- a) A grating, hinged or removable for maintenance access. The grating shall comprise at least 35% openings. The smaller dimension of any individual opening shall not exceed 35 mm,
- b) Capacity at the bottom for settlement of silt and debris, and
- c) A submerged (or trapped) outlet which prevents floatable solids entering the *drain*.

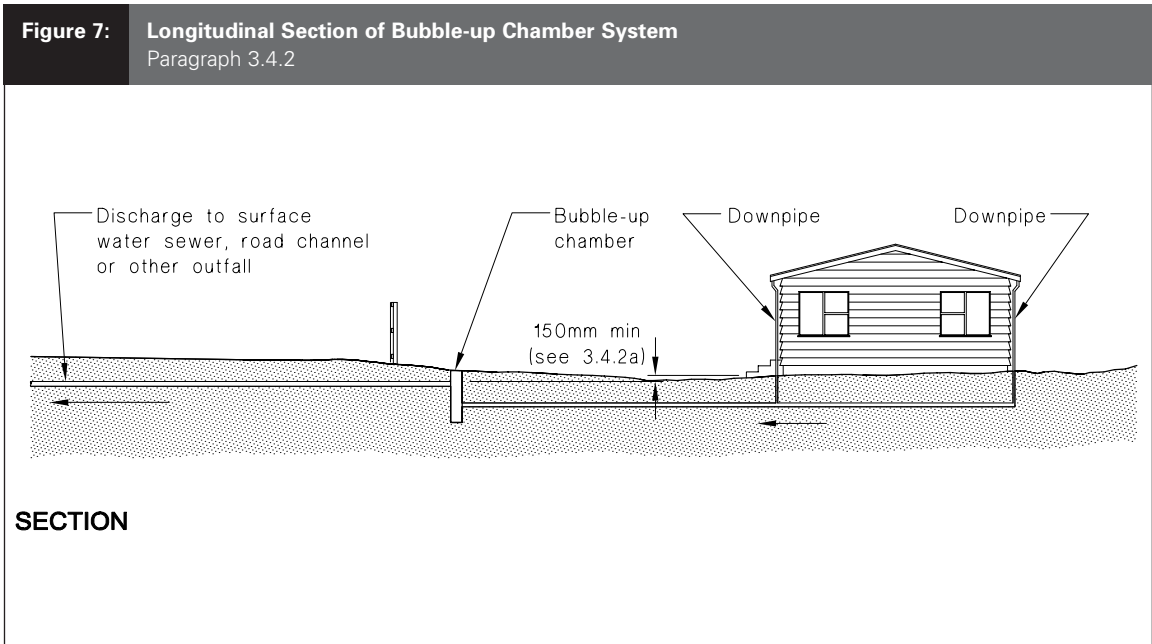


Table 3: Acceptable Jointing Methods
Paragraph 3.5.2

Pipe material	Jointing method	Standard
Concrete	Rubber ring	NZS/BS 2494
Ceramic	Rubber ring or rubber sleeve	NZS/BS 2494, NZS 3302
Vitrified clay	Rubber ring or rubber sleeve	NZS/BS 2494, NZS 3302
Steel	Rubber ring, welded or flanged	NZS/BS 2494, NZS 4442, NZS/BS 1560
Ductile iron	Rubber ring or flanged	AS 2280
uPVC	Rubber ring or solvent welded	NZS/BS 2494, NZS 7643, AS 1254
HDPE	Heat welded or flanged	NZS/AS 2033
ABS	Solvent welded or flanged	NZS 7609

3.6.2 Two different *sumps* are shown in Figures 8 and 9. The *sump* shown in Figure 8 is suitable for an area of up to 4500/l m² and the *sump* illustrated by Figure 9 is suitable for an area up to 40,000/l m², where l is the rainfall intensity for a storm with a 10% probability of occurring annually. (See Paragraph 3.2.2.)

3.7 Access for maintenance

3.7.1 Access for maintenance shall be provided on all *drains*. Access is to be achieved via an *inspection point*, *rodding point*, *inspection chamber* or *access chamber*, complying as appropriate with Figures 10, 11 or 12.

COMMENT:

Rodding points rather than *inspection points* are preferred in landscaped or sealed areas.

3.7.2 Points of access shall be spaced at no further than:

- a) 50 m where *rodding points* are used.
- b) 100 m where *inspection points*, *inspection chambers* or *access chambers* are used.

3.7.3 Points of access are required at:

- a) Changes in direction of greater than 45°,
- b) Changes in gradient of greater than 45°, and

c) Junctions of *drains* other than a *drain*, serving a single downpipe, that is less than 2.0 m long.

3.7.4 *Inspection chambers* or *access chambers* (see Figures 11 and 12) shall be provided where changes in both gradient and direction occur and where either is greater than 22.5°.

Amend 1
Sep 1993




3.7.5 Where the depth to the invert of the *drain* exceeds 1.0 m, an *inspection chamber* is not acceptable and an *access chamber* shall be used.



3.7.6 Drain under buildings

Any *drain* laid under a *building* shall be run in a straight line from one side to the other.

3.7.7 Access to a *drain* laid under a *building* shall be provided immediately outside the *building*. These points of access shall be located within 2.0 m of an exterior wall.

3.7.8 Under a *building* the only acceptable inlets to a *drain* are from sealed roof-water downpipes. Access shall be provided to the *drain* via a sealed access point in the downpipe immediately above ground floor level.

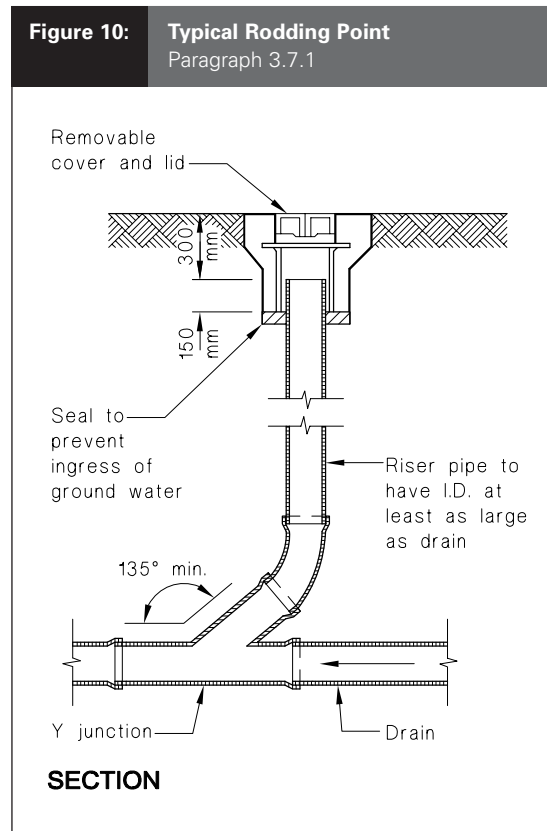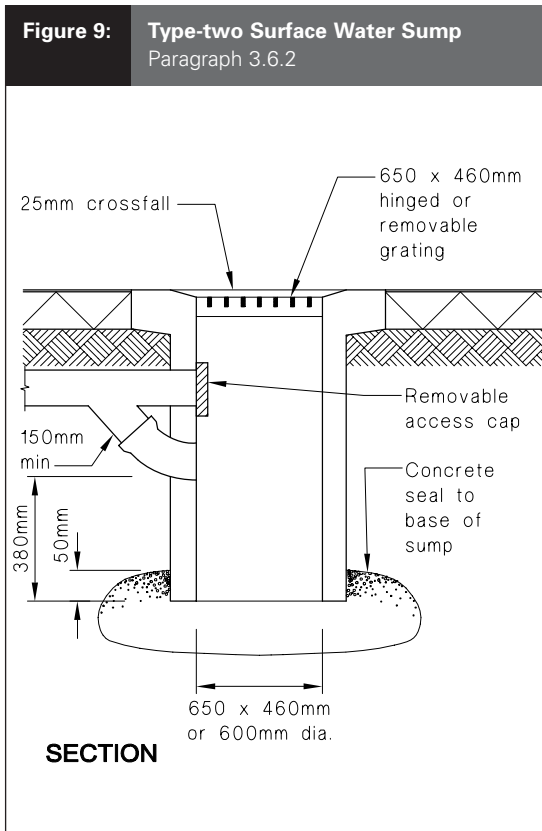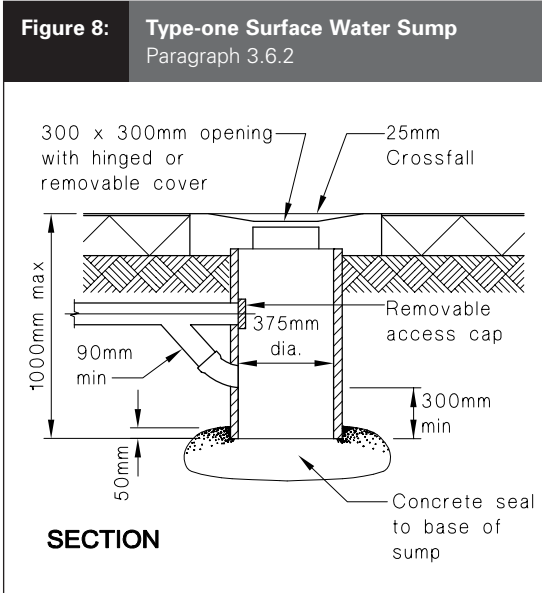

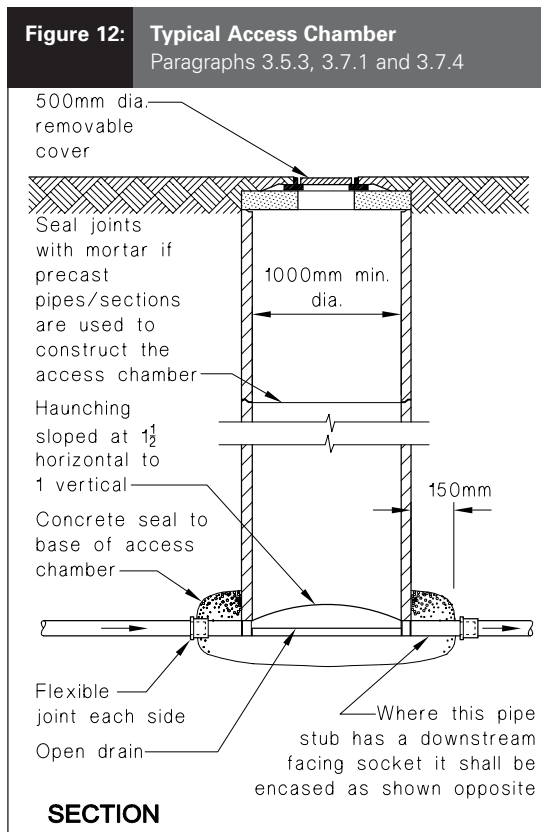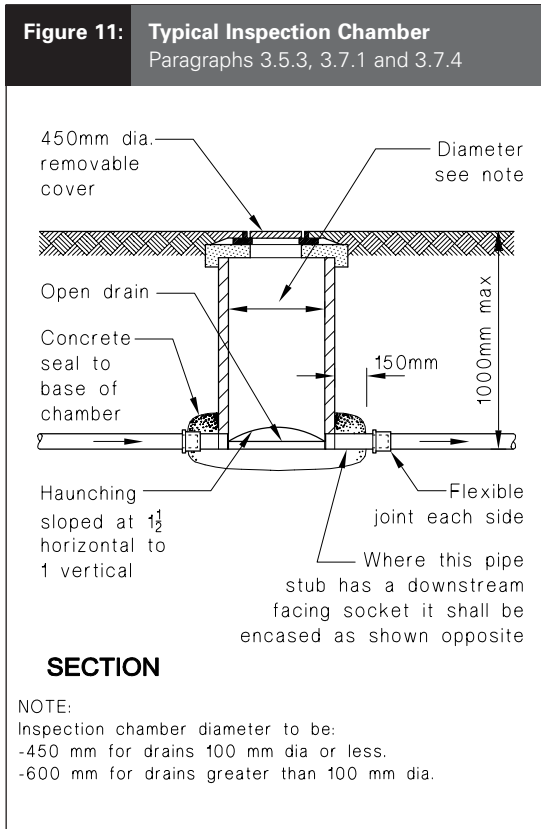

3.8 Testing of drains

3.8.1 Surface water drains shall be capable of passing one of the tests described in E1/VM1 Paragraph 8.0.

Amend 5
Jul 2001

3.9 Bedding and backfilling

3.9.1 General

NZBC B1 requires all drains be constructed to withstand the combination and frequency of loads likely to be placed upon them without collapse, undue damage, undue deflection or undue vibration. In addition, adequate support needs to be provided to prevent gradients becoming less than those required by Paragraph 3.4.1 as a result of:

- a) Differential settlement, or
- b) Deflection of an unsupported span.

3.9.2 Bedding and backfilling

Figure 13 gives acceptable solutions for the bedding and backfilling of the drainage pipes listed in Table 1 except where:

- a) The trench is located within or above peat, or
- b) Scouring of the trench is likely due to unstable soils, or
- c) The horizontal separation between any building foundation and the underside of the pipe trench is less than that required by Paragraph 3.9.7, or
- d) The cover H to the pipe is more than 2.5 m.


3.9.3 Trench slope

Where the slope of the trench is 1 in 8 or greater, anti-scour blocks shall be provided. These anti-scour blocks shall be:


- a) Constructed from 150 mm thick concrete (17 MPa),
- b) Keyed into the sides and floor of the trench by 150 mm,
- c) Extended to 300 mm above the drain or to ground level where the drain cover is less than 300 mm, and

Continued on page 41


Figure 13: Bedding and Backfilling
 Paragraphs 3.9.2, 3.9.4 and 3.9.5

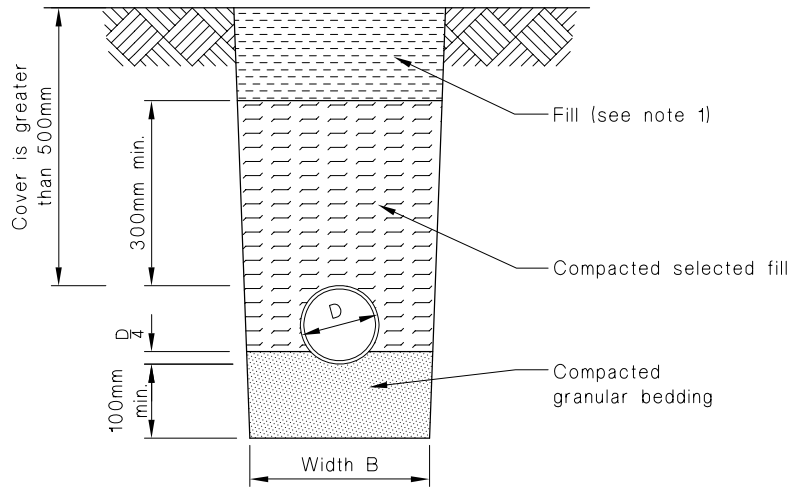

(a) Cover greater than 500 mm
 Bedding type 'B' of NZS 4452

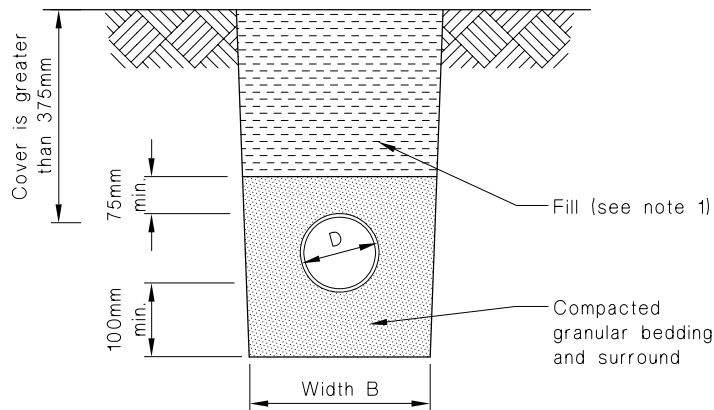

(b) Cover greater than 375 mm
 Bedding type 'D' of NZS 4452

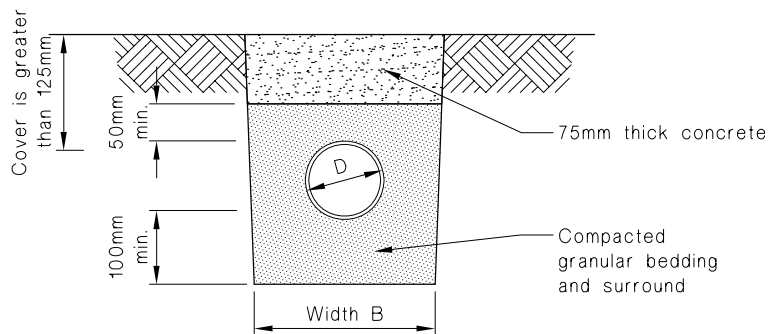

(c) Cover greater than 125 mm

NOTE:

1. Fill shall be:
 - Ordinary fill where drains are located below gardens and open country.
 - Compacted selected fill where the drains are located below residential driveways and similar areas subjected to light traffic.

Amend 1
 Sep 1993

Amend 1
 Sep 1993

Amend 1
 Sep 1993

Amend 1
 Sep 1993

Amend 1
 Sep 1993

Amend 1
 Sep 1993

- d) Spaced at:
- i) 7.5 m centres for trench slopes between 1 in 8 and 1 in 5, or
 - ii) 5.0 m centres for trench slopes greater than 1 in 5.

COMMENT:

The anti-scour blocks partition off the trench and prevent ground or *surface water* running along the trench and causing scouring.

3.9.4 Trench width

The width B of the trench shall be no less than the pipe diameter D plus 200 mm. Trench width at the top of the pipe shall be no more than 600 mm unless the pipe(s) in the trench are covered with concrete, as shown in Figure 13 (c).

3.9.5 Acceptable materials

Acceptable fill materials shown in Figure 13 are:

- a) Bedding material of clean granular non-cohesive material with a maximum particle size of 20 mm, or
- b) Selected compacted fill of any fine-grained soil or granular material which is free from topsoil and rubbish and has a maximum particle size of 20 mm, or
- c) Ordinary fill which may comprise any fill or excavated material.

3.9.6 Placing and compacting

- a) Granular bedding and selected fill shall be placed in layers of no greater than 100 mm loose thickness and compacted.
- b) Up to 300 mm above the pipe, compaction shall be by tamping by hand using a rod with a pad foot (having an area of 75 ± 25 mm by 75 ± 25 mm) over the entire surface of each layer to produce a compact layer without obvious voids.
- c) More than 300 mm above the pipe, compaction shall be by at least four passes of a mechanical tamping foot compactor (whacker type) with a minimum weight of 75 kg.

3.9.7 Proximity of trench to building

For light timber frame and concrete masonry *buildings* founded on *good ground* and constructed in accordance with NZS 3604 or NZS 4229, pipe trenches which are open for no longer than 48 hours shall be located no closer than distance 'V' (see Figure 14) to the underside of any *building* foundation. Where the trench is to remain open for periods longer than 48 hours, the minimum horizontal separation shall increase to 3V in all ground except rock.


3.9.8 NZS 7643 and NZS 4452 provide alternative acceptable solutions.

Amend 2
Aug 1994

COMMENT:

These provisions may exceed New Zealand Building Code minimum requirements.

Figure 14: Relationship of Pipe Trench to Building Foundation
Paragraph 3.9.7

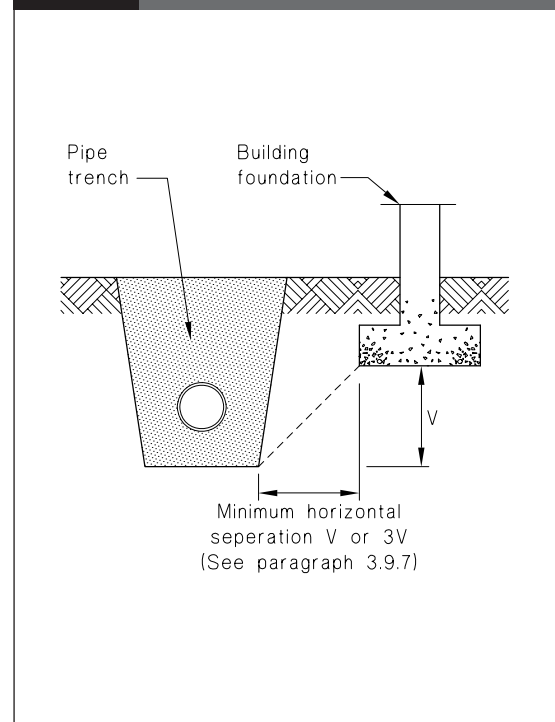

Amend 1
Sep 1993

4.0 Downpipes

4.1 Materials

4.1.1 Materials for downpipes shall comply with Table 4.

uPVC	NZS 7642 or AS 1273
Galvanised steel	NZS 3441
Zinc	BS 6561
Copper	BS 2870
Aluminium	BS 1470
Stainless steel	NZS/BS 970

Amend 1
Sep 1993
Amend 2
Aug 1994

4.1.2 Downpipes, gutters, roofing, fastenings and all adjoining components shall be of the same or a compatible material to eliminate the risk of galvanic corrosion.

4.2 Sizing of downpipes

4.2.1 Downpipes sized using Table 5 are acceptable. Other downpipes are acceptable provided their cross-sectional area is no less than that required by Table 5, and they permit passage of a 50 mm diameter sphere.

Downpipe size (mm) (minimum internal sizes)	Roof pitch			
	0-25°	25-35°	35-45°	45-55°
Plan area of roof served by the downpipe (m²)				
63 mm diameter	60	50	40	35
74 mm diameter	85	70	60	50
100 mm diameter	155	130	110	90
150 mm diameter	350	290	250	200
65 x 50 rectangular	60	50	40	35
100 x 50 rectangular	100	80	70	60
75 x 75 rectangular	110	90	80	65
100 x 75 rectangular	150	120	105	90

Amend 1
Sep 1993

Amend 2
Aug 1994

4.3 Installation of downpipes

4.3.1 Where thermal movement of downpipes cannot be accommodated by movement of the guttering, expansion joints shall be incorporated.

4.3.2 All internal downpipes shall withstand without leakage, a water test with an applied head of 1.5 m of water, or a high pressure air test as described in E1/MM1 Paragraph 8.3.

Amend 5
Jul 2001

5.0 Roof Gutters

5.1 Size of roof gutters

5.1.1 Roof gutters shall discharge to downpipes that are sized as given in Paragraph 4.2.

5.1.2 Any gutter under consideration shall be divided into sections and each section shall be sized. A section shall comprise the length of gutter between a downpipe and the adjacent high point on one side only of that downpipe. Each section of gutter shall have a cross-sectional area of no less than that determined from Figure 15 or Figure 16 (depending on whether the gutter is external or internal), and increased where required in accordance with Paragraph 5.1.3.


5.1.3 Figures 15 and 16 are based on a rainfall intensity "I" of 100 mm/hr. Where "I" exceeds 100 mm/hr the required gutter size shall be increased by taking the value read from the figures and multiplying it by the ratio of "I"/100. Paragraph 3.2.2 describes how to determine the value of "I".

Amend 2
Aug 1994

Amend 2
Aug 1994


Amend 1
Sep 1993

Figure 15: Cross-sectional Area of External Gutter
 Paragraphs 5.1.2 and 5.1.3

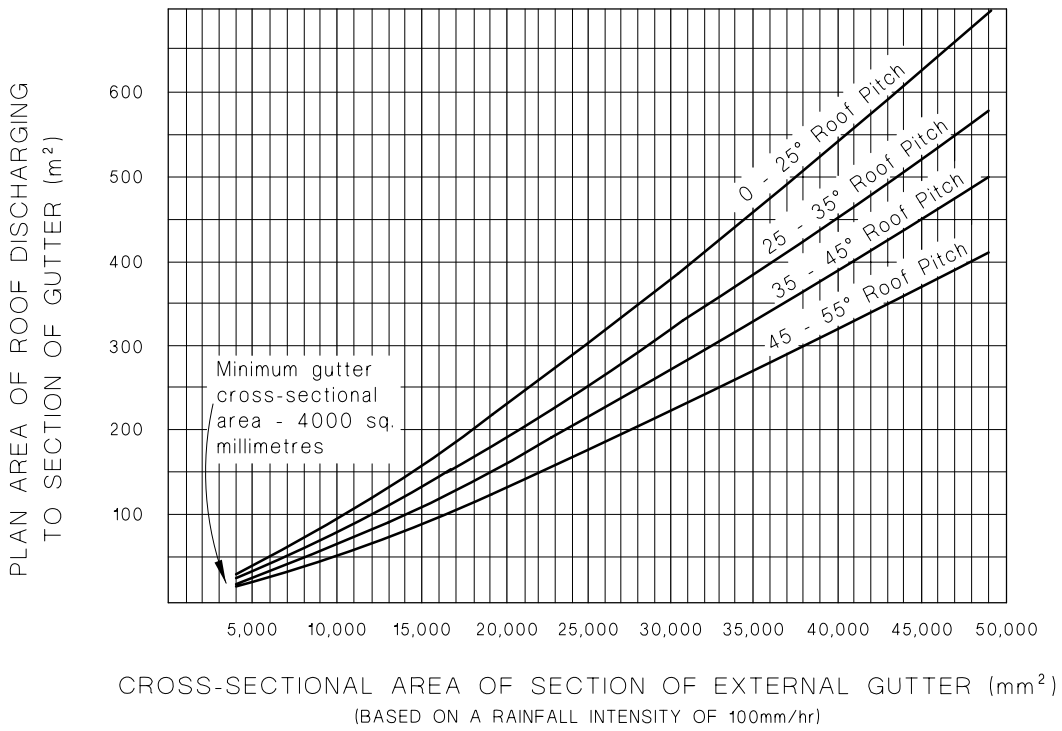

Amend 1
 Sep 1993

Figure 16: Cross-sectional Area of Internal Gutter
 Paragraphs 5.1.2 and 5.1.3

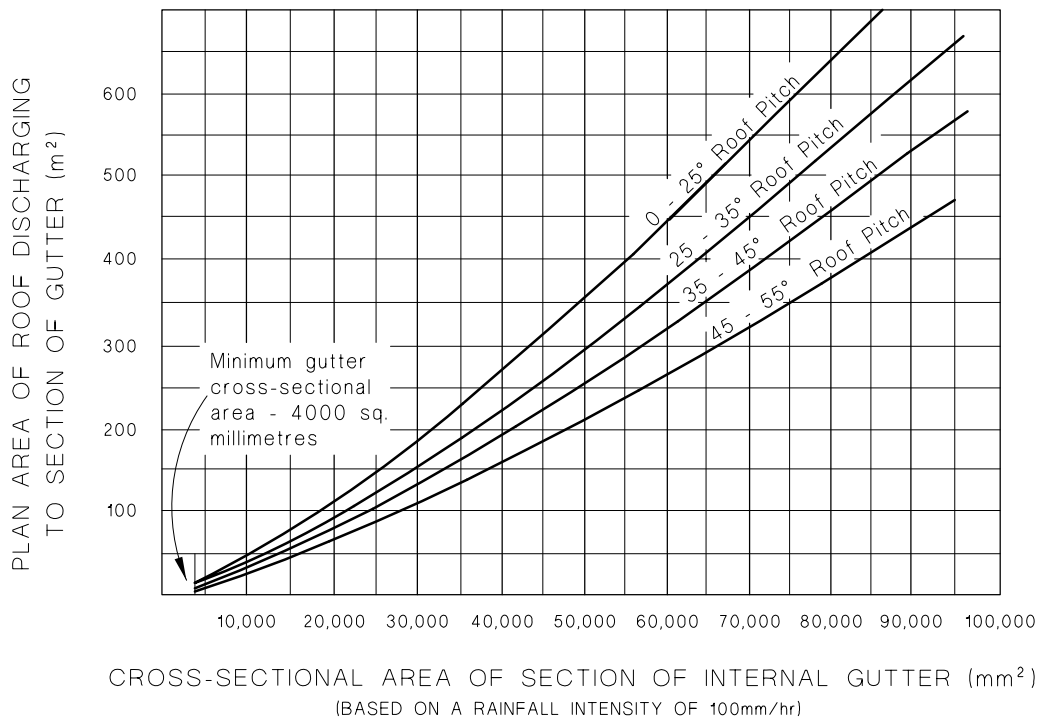

Amend 1
 Sep 1993

Amend 1
Sep 1993

5.1.4 In no case shall the cross-sectional area of any gutter be less than 4000 mm².

5.2 Materials

5.2.1 Roof gutter materials shall comply with the standards stated in Table 6.

COMMENT:

Proprietary membrane systems using bitumen, rubber or epoxy resins may also be acceptable.

Table 7: Thermal Expansion of 5 m length over 50°C
Paragraph 5.4.1

Material	Expansion (mm)
uPVC	17.5
Zinc	5.0
Galvanised steel	2.5
Copper	4.5
Aluminium	5.8
Stainless steel	3.8

Table 6: Acceptable Material Standards for Roof Gutters
Paragraph 5.2.1

uPVC	AS 1273
Zinc	BS 6561
Galvanised steel	NZS 3441
Copper	BS 2870
Aluminium	BS 1470
Stainless steel	NZS/BS 970
Concrete	NZS 3124

Amend 2
Aug 1994

5.5 Overflow outlets

5.5.1 All internal gutters shall be fitted with overflow outlets which drain to the exterior of the *building*. The top of the outlet shall be set at least 50 mm below the top of the gutter. The cross-sectional area of the outlet shall be no less than the cross-sectional area of the downpipes (determined by Paragraph 4.2.1) serving the gutter.

COMMENT:

An internal gutter overflow outlet should be located to give an early, conspicuous warning to the *building* occupier that maintenance is required.

5.3 Gradients

5.3.1 Roof gutters shall fall to an outlet.


5.4 Thermal movement

5.4.1 Allowance shall be made for the thermal expansion and contraction of gutters. Table 7 shows for different materials the change in length of 5.0 m of guttering when subjected to a 50°C change in temperature.

COMMENT:

The provision of expansion joints is particularly important where both ends of a gutter are restrained against movement, and on uPVC guttering due to its relatively high rate of thermal expansion.


Appendix A Rainfall Intensities

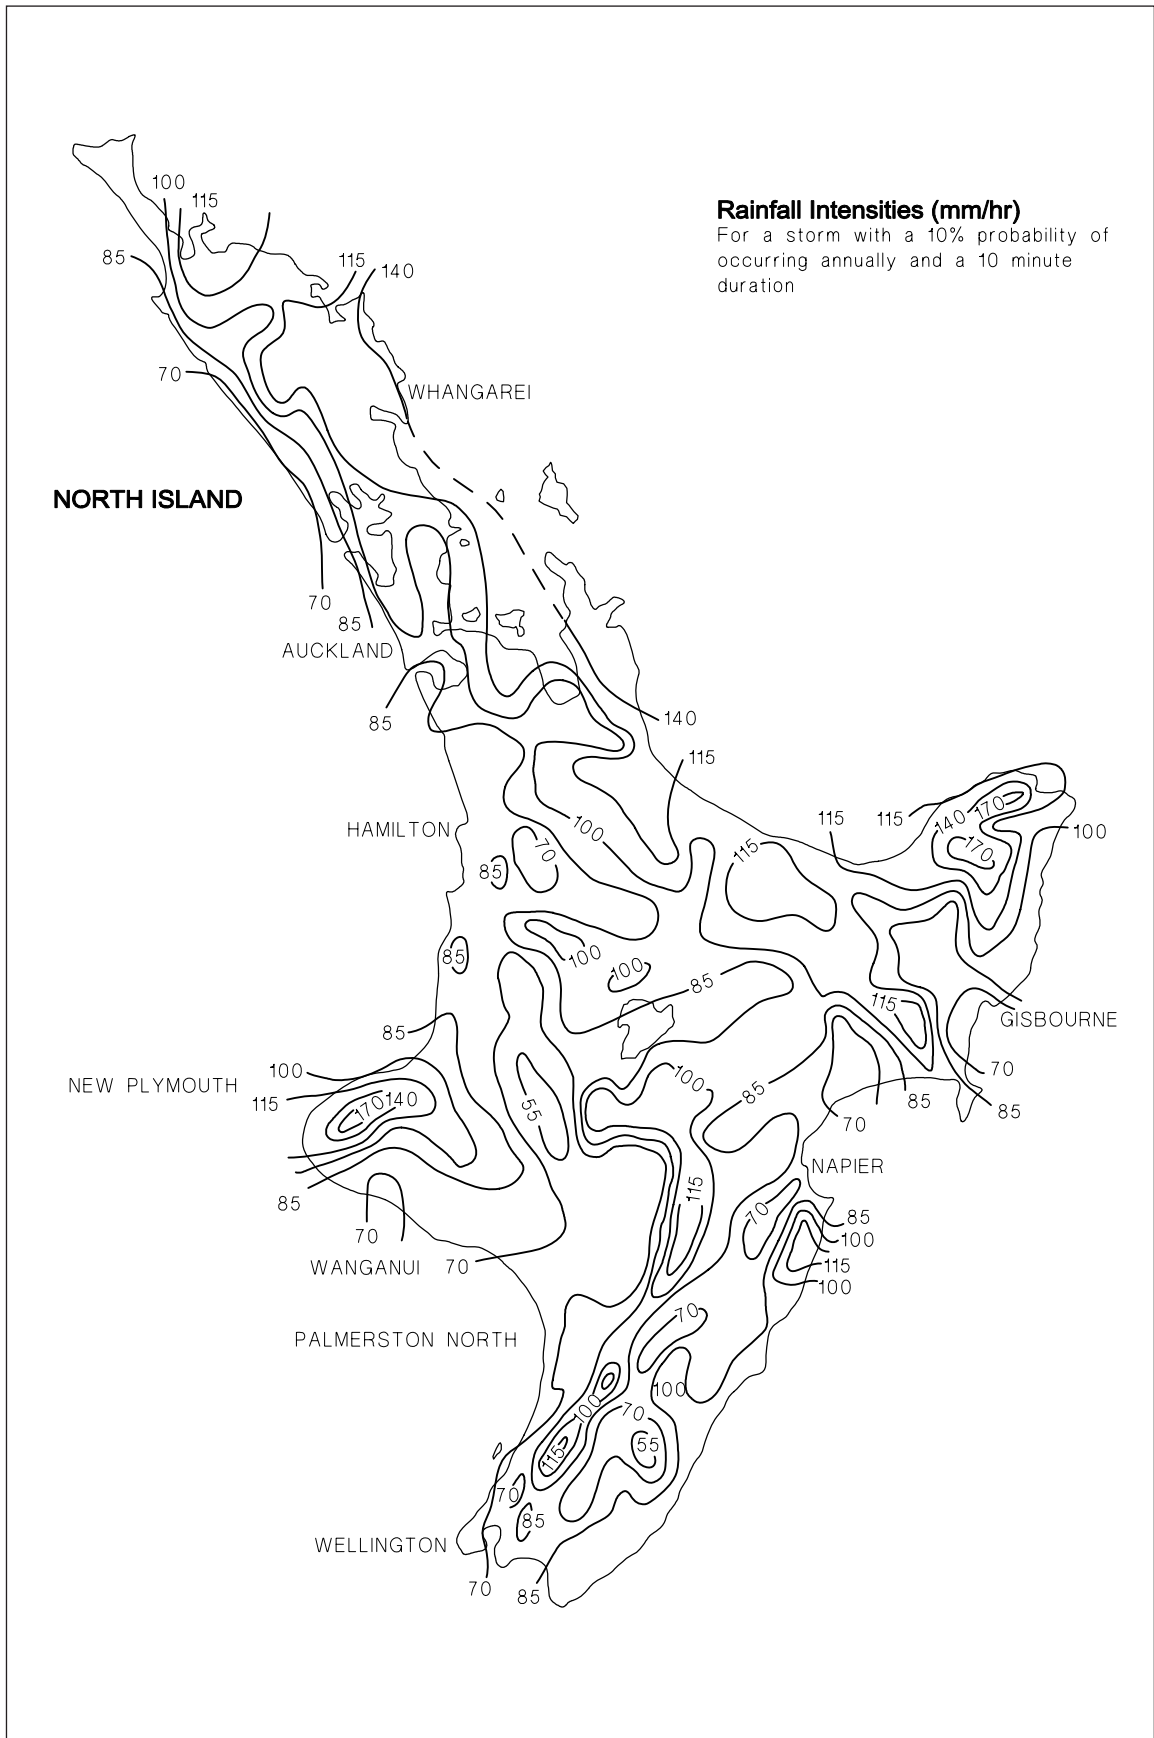

Rainfall Intensities (mm/hr)

For a storm with a 10% probability of occurring annually and a 10 minute duration

SOUTH ISLAND

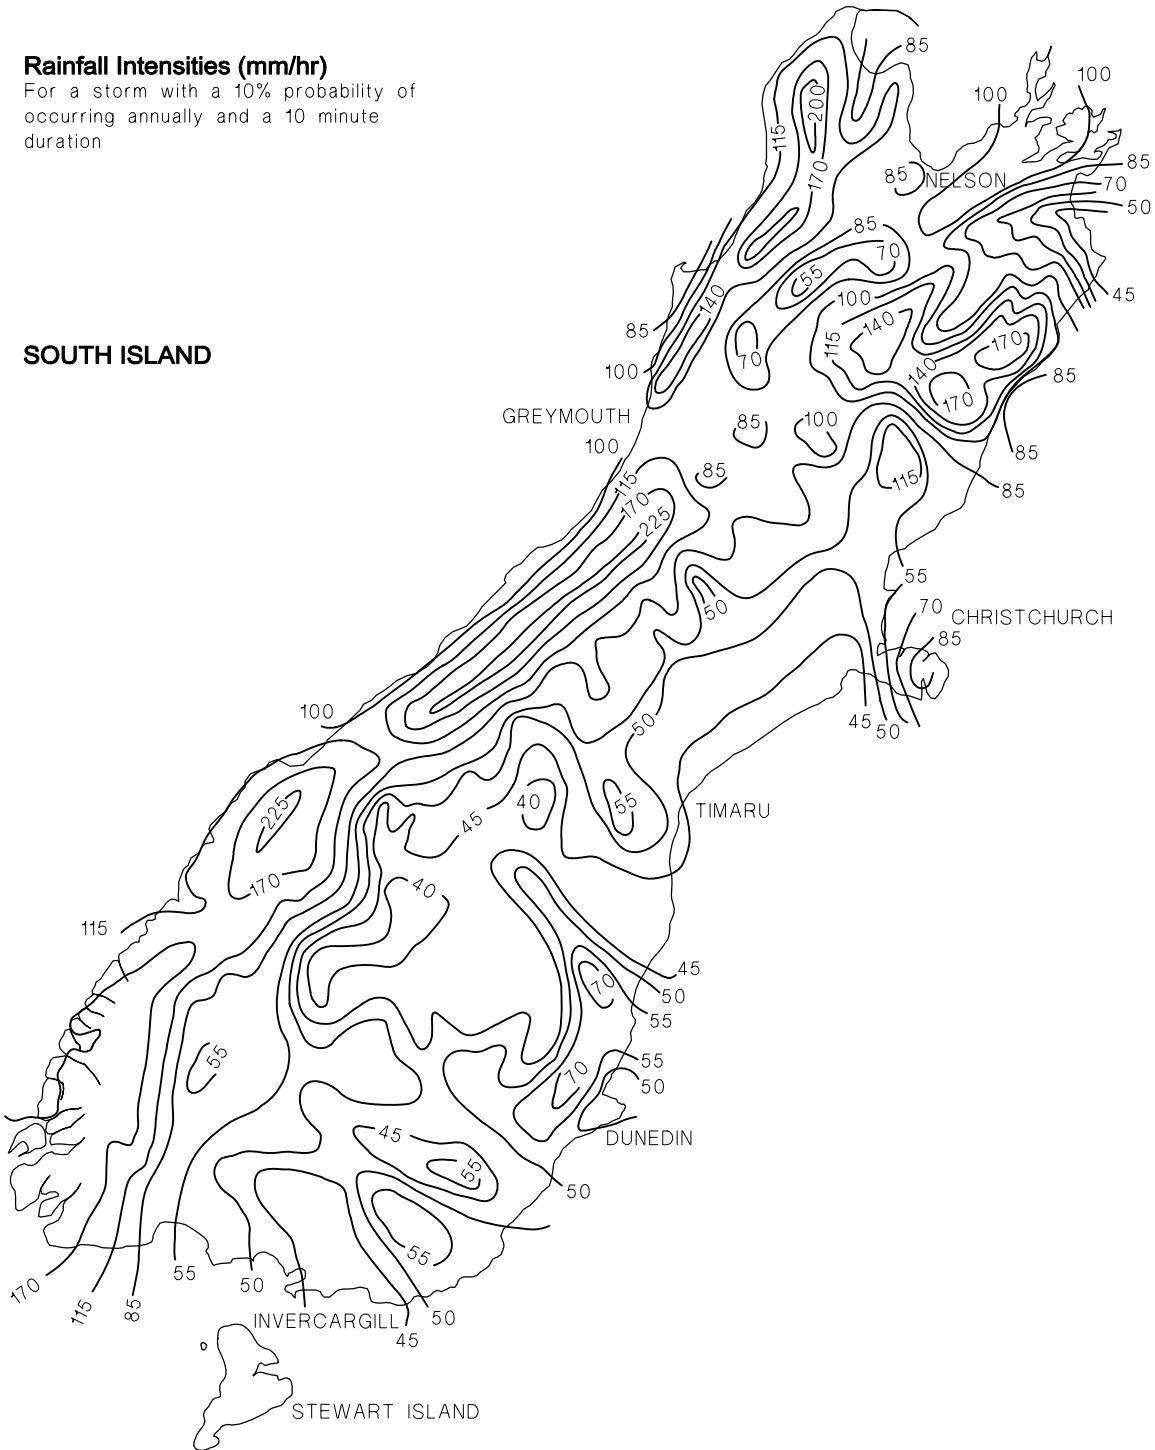

Index E1/VM1 & AS1

(Revised by Amendment 4)

All references to Verification Methods and Acceptable Solutions are preceded by **VM** or **AS** respectively.

Building site	VM1 3.2.2, 4.0.1, 4.1.10, AS1 1.0.1
evaluation	VM1 1.0.3
Buildings	AS1 1.0.1
minimum floor level	AS1 2.0, Figures 1 and 2
Catchment	
characteristics	VM1 1.0.2, 2.0.1, 2.1, 2.3, 4.2.1
Downpipes	AS1 3.4.2 b), 3.7.8, 4.0, 5.1.1
installation	AS1 4.3
materials	AS1 4.1, Table 4
sizing	AS1 4.2, Table 5
Drainage	
access points	AS1 3.7, 3.7.3, 3.7.7, 3.7.8
access chambers	VM1 5.0.1, AS1 3.7.1, 3.7.2 b), 3.7.4, 3.7.5, Figure 12
inspection chambers	AS1 3.7.1, 3.7.2 b), 3.7.4, 3.7.5, Figure 11
inspection points	AS1 3.7.1, 3.7.2 b)
rodding points	AS1 3.7.1, 3.7.2 a), Figure 10
alignment	AS1 3.3, 3.7.3 a), Figures 4 and 5
bedding and backfilling	AS1 3.9, 3.9.2, Figure 13
alternative solutions	AS1 3.9.8
materials	AS1 3.9.5
placing and compacting	AS1 3.9.6
proximity to buildings	AS1 3.9.7, Figure 14
trench slope	AS1 3.9.3
trench width	AS1 3.9.4
bubble-up chamber system	AS1 3.4.2, Figures 6 and 7
downstream water systems	VM1 4.3
drains under buildings	AS1 3.7.6, 3.7.7, 3.7.8
gradient	AS1 3.3.1, 3.7.3 b)
minimum gradient	AS1 3.4, Table 2
joints	AS1 3.5, Table 3
leakage tests	VM1 8.0, AS1 3.8
high pressure air test	VM1 8.3
low pressure air test	VM1 8.2
water test	VM1 8.1
materials	AS1 3.1, Table 1
open water, upstream of site	VM1 4.2
piped water, upstream of site	VM1 4.1
quantity	VM1 4.1.10
tailwater depth	VM1 4.1.6, 4.1.7

Drainage (*continued*)

- secondary flow **VM1** 4.0, **AS1** 1.0.1 d)
- downstream drainage **VM1** 4.3
- flow **VM1** 4.1.11
- headwater depth **VM1** 4.1.4, 4.1.5, 4.1.8,
4.1.9, Figures 5, 6, 7, 10 and 11
- site – outfall protection **VM1** 7.0
- sizing **VM1** 3.0, **AS1** 3.2, Figure 3
- energy losses **VM1** 5.0
- hydraulic design of drains **VM1** 1.0.4, 3.2, Figures 6 and 7
- air entrainment **VM1** 3.2.4
- headwater depth **VM1** 3.2.2, Figure 5 a)
- minimum size **VM1** 3.1
- minimum velocity **VM1** 6.0
- pipe size decrease **VM1** 5.0.2
- soak pits **VM1** 9.0, Figure 13
- sumps **AS1** 3.6.1, 3.6.2, Figures 8 and 9
- surface water inlets **AS1** 3.6
- upstream water systems **VM1** 4.1, 4.2

Flooding

- flood risk assessment **VM1** 3.2.2
- historical information **AS1** 1.0.1
- protection from **VM1** 3.2.2

Gutters

- gradients **AS1** 5.0
- materials **AS1** 5.3
- materials **AS1** 5.2, Table 6
- overflow outlets **AS1** 5.5
- sizing **AS1** 5.1, Figures 15 and 16
- thermal movement **AS1** 5.4, Table 7

Run-off

- estimation of run-off **VM1** 2.0
- Rational Method **VM1** 2.0.1
- rainfall intensity **VM1** 2.2, **AS1** Appendix A
- run-off coefficient **VM1** 2.1, Table 1
- slope correction **VM1** 2.1.3, Table 2
- time of concentration **VM1** 2.2.1, 2.3
- alternative procedure **VM1** 2.3.6, 2.3.7
- catchment slopes **VM1** 2.3.7
- open channel flow **VM1** 2.3.5
- pipe flow **VM1** 2.3.4, Table 1
- time of entry **VM1** 2.3.2
- overland flow **VM1** 2.3.2 b), Figure 1
- road channel flow **VM1** 2.3.2 b), Figure 2
- time of network flow **VM1** 2.3.3